



SPECIFICATION FOR APPROVAL

Customer.	STD
-----------	-----

Description.	DC	FAN
1. <i>How many people are in your household?</i>	1.00	1.00
2. <i>How many people are in your family?</i>	1.00	1.00
3. <i>How many people are in your community?</i>	1.00	1.00
4. <i>How many people are in your country?</i>	1.00	1.00
5. <i>How many people are in the world?</i>	1.00	1.00
6. <i>How many people are in the universe?</i>	1.00	1.00
7. <i>How many people are in the galaxy?</i>	1.00	1.00
8. <i>How many people are in the solar system?</i>	1.00	1.00
9. <i>How many people are in the planet?</i>	1.00	1.00
10. <i>How many people are in the country?</i>	1.00	1.00
11. <i>How many people are in the state?</i>	1.00	1.00
12. <i>How many people are in the city?</i>	1.00	1.00
13. <i>How many people are in the neighborhood?</i>	1.00	1.00
14. <i>How many people are in the street?</i>	1.00	1.00
15. <i>How many people are in the house?</i>	1.00	1.00
16. <i>How many people are in the room?</i>	1.00	1.00
17. <i>How many people are in the building?</i>	1.00	1.00
18. <i>How many people are in the town?</i>	1.00	1.00
19. <i>How many people are in the village?</i>	1.00	1.00
20. <i>How many people are in the world?</i>	1.00	1.00
21. <i>How many people are in the universe?</i>	1.00	1.00
22. <i>How many people are in the galaxy?</i>	1.00	1.00
23. <i>How many people are in the solar system?</i>	1.00	1.00
24. <i>How many people are in the planet?</i>	1.00	1.00
25. <i>How many people are in the country?</i>	1.00	1.00
26. <i>How many people are in the state?</i>	1.00	1.00
27. <i>How many people are in the city?</i>	1.00	1.00
28. <i>How many people are in the neighborhood?</i>	1.00	1.00
29. <i>How many people are in the street?</i>	1.00	1.00
30. <i>How many people are in the house?</i>	1.00	1.00
31. <i>How many people are in the room?</i>	1.00	1.00
32. <i>How many people are in the building?</i>	1.00	1.00
33. <i>How many people are in the town?</i>	1.00	1.00
34. <i>How many people are in the village?</i>	1.00	1.00
35. <i>How many people are in the world?</i>	1.00	1.00
36. <i>How many people are in the universe?</i>	1.00	1.00
37. <i>How many people are in the galaxy?</i>	1.00	1.00
38. <i>How many people are in the solar system?</i>	1.00	1.00
39. <i>How many people are in the planet?</i>	1.00	1.00
40. <i>How many people are in the country?</i>	1.00	1.00
41. <i>How many people are in the state?</i>	1.00	1.00
42. <i>How many people are in the city?</i>	1.00	1.00
43. <i>How many people are in the neighborhood?</i>	1.00	1.00
44. <i>How many people are in the street?</i>	1.00	1.00
45. <i>How many people are in the house?</i>	1.00	1.00
46. <i>How many people are in the room?</i>	1.00	1.00
47. <i>How many people are in the building?</i>	1.00	1.00
48. <i>How many people are in the town?</i>	1.00	1.00
49. <i>How many people are in the village?</i>	1.00	1.00
50. <i>How many people are in the world?</i>	1.00	1.00
51. <i>How many people are in the universe?</i>	1.00	1.00
52. <i>How many people are in the galaxy?</i>	1.00	1.00
53. <i>How many people are in the solar system?</i>	1.00	1.00
54. <i>How many people are in the planet?</i>	1.00	1.00
55. <i>How many people are in the country?</i>	1.00	1.00
56. <i>How many people are in the state?</i>	1.00	1.00
57. <i>How many people are in the city?</i>	1.00	1.00
58. <i>How many people are in the neighborhood?</i>	1.00	1.00
59. <i>How many people are in the street?</i>	1.00	1.00
60. <i>How many people are in the house?</i>	1.00	1.00
61. <i>How many people are in the room?</i>	1.00	1.00
62. <i>How many people are in the building?</i>	1.00	1.00
63. <i>How many people are in the town?</i>	1.00	1.00
64. <i>How many people are in the village?</i>	1.00	1.00
65. <i>How many people are in the world?</i>	1.00	1.00
66. <i>How many people are in the universe?</i>	1.00	1.00
67. <i>How many people are in the galaxy?</i>	1.00	1.00
68. <i>How many people are in the solar system?</i>	1.00	1.00
69. <i>How many people are in the planet?</i>	1.00	1.00
70. <i>How many people are in the country?</i>	1.00	1.00
71. <i>How many people are in the state?</i>	1.00	1.00
72. <i>How many people are in the city?</i>	1.00	1.00
73. <i>How many people are in the neighborhood?</i>	1.00	1.00
74. <i>How many people are in the street?</i>	1.00	1.00
75. <i>How many people are in the house?</i>	1.00	1.00
76. <i>How many people are in the room?</i>	1.00	1.00
77. <i>How many people are in the building?</i>	1.00	1.00
78. <i>How many people are in the town?</i>	1.00	1.00
79. <i>How many people are in the village?</i>	1.00	1.00
80. <i>How many people are in the world?</i>	1.00	1.00
81. <i>How many people are in the universe?</i>	1.00	1.00
82. <i>How many people are in the galaxy?</i>	1.00	1.00
83. <i>How many people are in the solar system?</i>	1.00	1.00
84. <i>How many people are in the planet?</i>	1.00	1.00
85. <i>How many people are in the country?</i>		

Part No.	REV.
----------	------

Delta Model No. GFC0412DS-DV17 REV. 02

Sample Issue No.

Sample Issue Date. MAY-21-2015

PLEASE SEND ONE COPY OF THIS SPECIFICATION BACK
AFTER YOU SIGNED APPROVAL FOR PRODUCTION PRE-
ARRANGMENT.

APPROVED BY:

DATE :
:

Delta Electronics, Inc.
HeTianXia High-Tech Industrial Park.
Shi Jie Town, Dong Guan City.
Guangdong Province, China. P. R. C.
TEL : 86-769-86329008
FAX : 86-769-86631589

Delta Electronics, Inc.
HeTianXia High-Tech Industrial Park.
Shi Jie Town, Dong Guan City.
Guangdong Province, China. P. R. C.

TEL : 86-769-86329008
FAX : 86-769-86631589

STATEMENT OF DEVIATION

☒ NONE

☐ DESCRIPTION :

Delta Electronics, Inc.
 HeTianXia High-Tech Industrial Park.
 Shi Jie Town, Dong Guan City.
 Guangdong Province, China. P. R. C.

TEL : 86-769-86329008
 FAX : 86-769-86631589

SPECIFICATION FOR APPROVAL

Customer:	STD		
Description:	DC FAN		
Customer P/N:	REV:B		
Delta Model NO.:	GFC0412DS-DV17	Delta Safety Model NO.:	GFC0412DS-SM06
Sample Rev:	02	Issue NO:	
Sample Issue Date:	MAY-21-2015	Quantity:	

1. SCOPE:

THIS SPECIFICATION DEFINES THE ELECTRICAL AND MECHANICAL CHARACTERISTICS OF THE DC BRUSHLESS AXIAL FLOW FAN. THE FAN MOTOR IS WITH SINGLE PHASES AND FOUR POLES.

2. CHARACTERS:

ITEM	DESCRIPTION
RATED VOLTAGE	12 VDC
OPERATION VOLTAGE	10.8 – 12.6 VDC
INPUT CURRENT	1.50 (MAX. 2.00) A (SAFETY CURRENT ON LABEL 2.80 A)
INPUT POWER	18.00 (MAX. 24.00) W
SPEED	FRONT 20500±10% / REAR 17600±10% R.P.M.
MAX. AIR FLOW (AT ZERO STATIC PRESSURE)	0.941 (MIN. 0.847) M ³ /MIN. 33.22 (MIN. 29.90) CFM
MAX. AIR PRESSURE (AT ZERO AIRFLOW)	84.58 (MIN. 68.50) mmH ₂ O 3.330 (MIN. 2.697) inchH ₂ O
ACOUSTICAL NOISE (AVG.)	66.0 (MAX. 70.0) dB-A
INSULATION TYPE	UL: CLASS A


(continued)

PART NO:

DELTA MODEL: GFC0412DS-DV17

INSULATION STRENGTH	10 MEG OHM MIN. AT 500 VDC (BETWEEN FRAME AND (+) TERMINAL)
DIELECTRIC STRENGTH	5 mA MAX. AT 500 VAC 50/60 Hz ONE MINUTE, (BETWEEN FRAME AND (+) TERMINAL)
EXTERNAL COVER	OPEN TYPE
LIFE EXPECTANCE (AT LABEL VOLTAGE)	70,000 HOURS CONTINUOUS OPERATION AT 40 °C WITH 15 ~ 65 %RH.
ROTATION	TWO FANS ROTATE IN COUNTER DIRECTIONS SHOWED IN THE NAME PLATE SIDE
OVER CURRENT SHUT DOWN	THE CURRENT WILL SHUT DOWN WHEN LOCKING ROTOR.

- NOTES:
1. ALL READINGS ARE MEASURED AFTER STABLY WARMING UP THROUGH 10 MINUTES.
 2. STANDARD AIR PROPERTY IS AIR AT (Td) 25°C TEMPERATURE, (RH) 65% RELATIVE HUMIDITY, AND (Pb) 760 mmHg BAROMETRIC PRESSURE.
 3. THE VALUES WRITTEN IN PARENS , (), ARE LIMITED SPEC.
 4. THE CHARACTERS SHOWED IN PAGE 1 IS THE CONDITION OF BOTH FANS RUN.
 5. ACOUSTICAL NOISE MEASURING CONDITION:

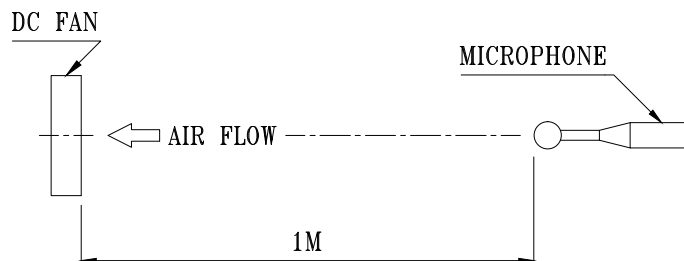

NOISE IS MEASURED AT RATED VOLTAGE IN FREE AIR IN ANECHOIC CHAMBER WITH B & K SOUND LEVEL METER WITH MICROPHONE AT A DISTANCE OF ONE METER FROM THE FAN INTAKE.

PART NO:

DELTA MODEL: GFC0412DS-DV17

3. MECHANICAL:

- 3-1. DIMENSIONS ----- SEE DIMENSIONS DRAWING
- 3-2. FRAME ----- PLASTIC UL: 94V-0
- 3-3. IMPELLER ----- PLASTIC UL: 94V-0
- 3-4. BEARING SYSTEM ----- TWO BALL BEARINGS
- 3-5. WEIGHT ----- 83 GRAMS(REF.)

4. ENVIRONMENTAL:

- 4-1. OPERATING TEMPERATURE ----- -10 TO +60 DEGREE C
- 4-2. STORAGE TEMPERATURE ----- -40 TO +75 DEGREE C
- 4-3. OPERATING HUMIDITY ----- 5 TO 90 % RH
- 4-4. STORAGE HUMIDITY ----- 5 TO 95 % RH

5. PROTECTION:

5-1. LOCKED ROTOR PROTECTION

IMPEDANCE OF MOTOR WINDING PROTECTS MOTOR FROM FIRE IN 96 HOURS OF LOCKED ROTOR CONDITION AT THE RATED VOLTAGE.

5-2. POLARITY PROTECTION

BE CAPABLE OF WITHSTANDING IF REVERSE CONNECTION FOR POSITIVE AND NEGATIVE LEADS.

6. RE OZONE DEPLETING SUBSTANCES:

- 6-1. NO CONTAINING PBBs, PBBOs, CFCs, PBBEs, PBDPEs AND HCFCs.

7. PRODUCTION LOCATION

- 7-1. PRODUCTS WILL BE PRODUCED IN CHINA OR THAILAND .


8. VIBRATION CONTROL

- 8-1. THE OVERALL VIBRATION CRITERIA, COMBINED BY RADIAL AND AXIAL DIRECTION, IS 0.6G MAX. BETWEEN 0~380HZ,. WHEN FAN SPEED IS DUTY CYCLE 100%.

PART NO:

DELTA MODEL: GFC0412DS-DV17

9. P & Q CURVE:

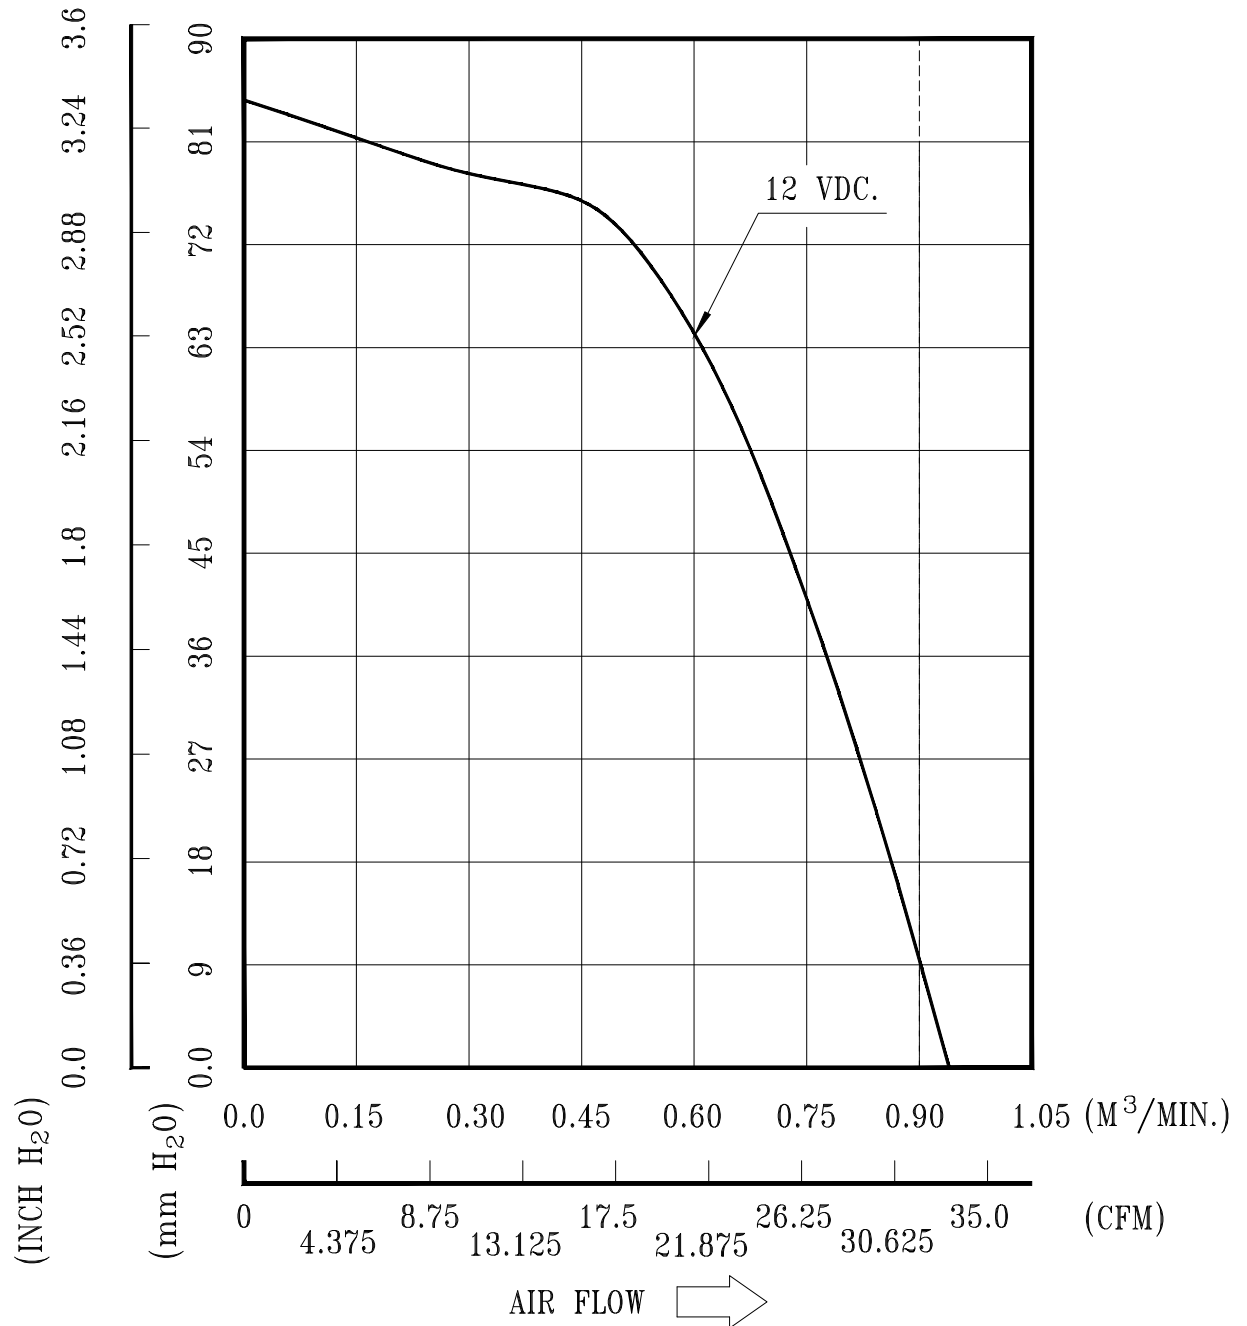


* TEST CONDITION: INPUT VOLTAGE ----- OPERATION VOLTAGE
TEMPERATURE ----- ROOM TEMPERATURE
HUMIDITY ----- 65%RH

PART NO:

DELTA MODEL: GFC0412DS-DV17

10. DIMENSION DRAWING:

LABEL:

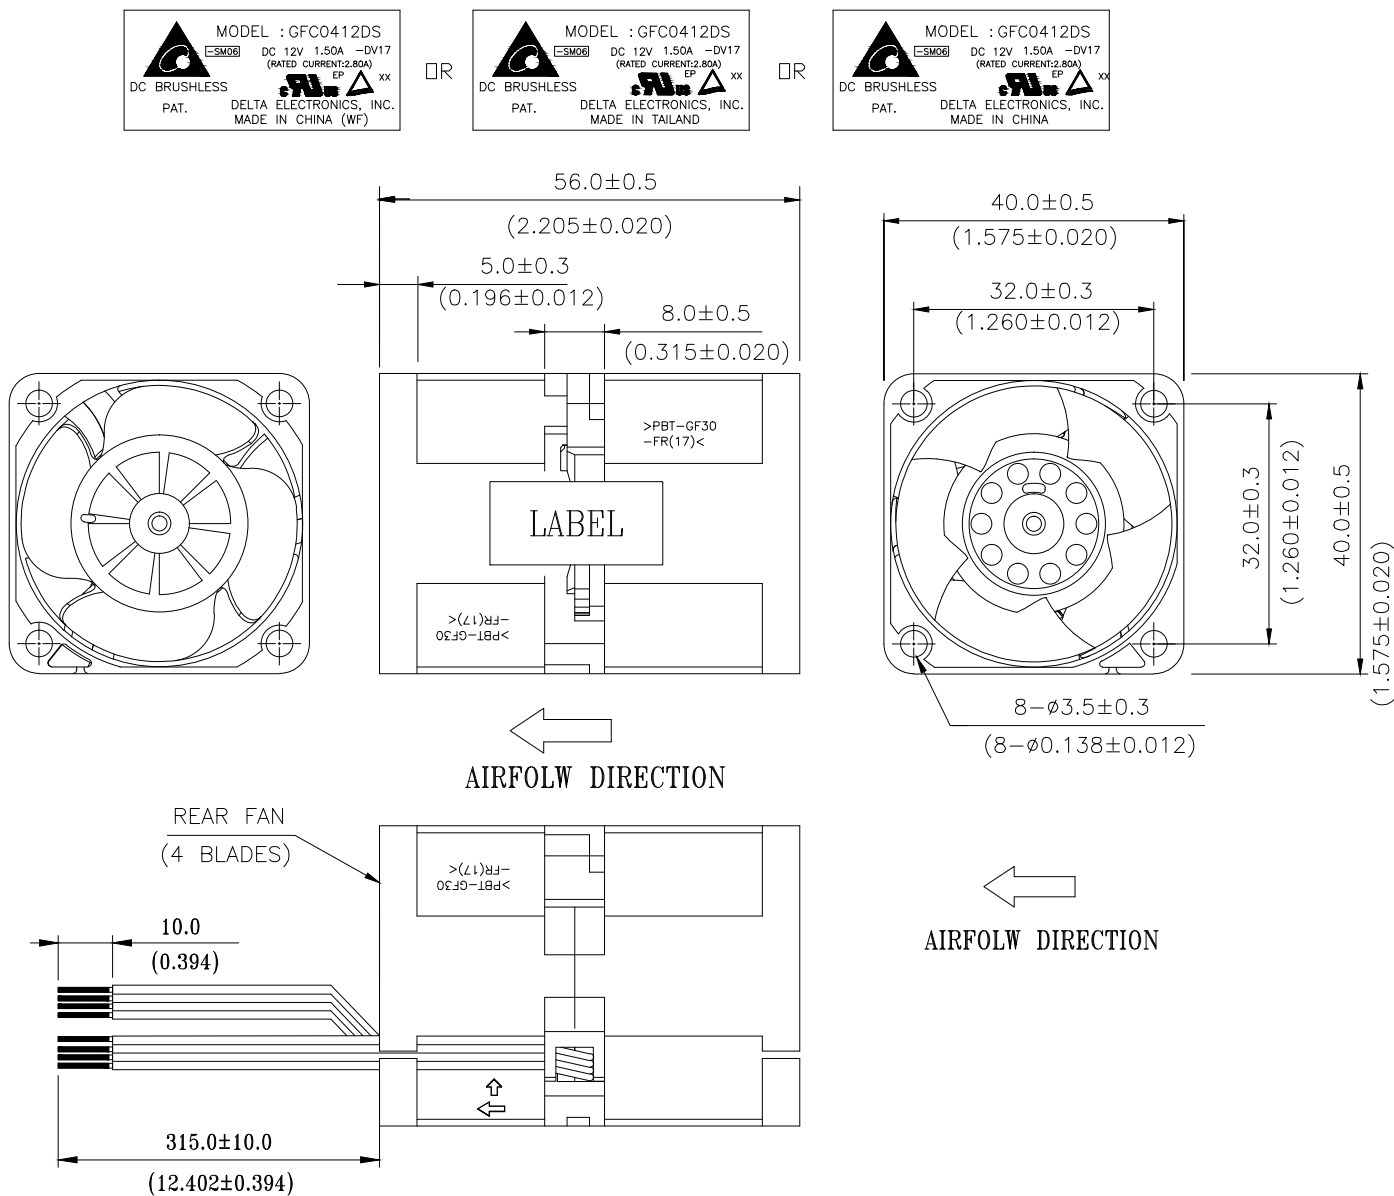

NOTES:

1. LEAD WIRE UL: 1061 AWG#28

FRONT FAN (5BLADES)	BLACK WIRE	-----(-)
	RED WIRE	-----(+)
	WHITE WIRE	----- (F00)
	GREEN WIRE	----- (PWM)
REAR FAN (4BLADES)	BROWN WIRE	-----(-)
	ORANGE WIRE	-----(+)
	BLUE WIRE	----- (RR0)
	YELLOW WIRE	----- (PWM)


2. THIS PRODUCT IS RoHS COMPLIANT.

PART NO:

DELTA MODEL: GFC0412DS-DV17

11. FREQUENCY GENERATOR (FG) SIGNAL (FRONT FAN):

11-1. OUTPUT CIRCUIT - OPEN COLLECTOR MODE:

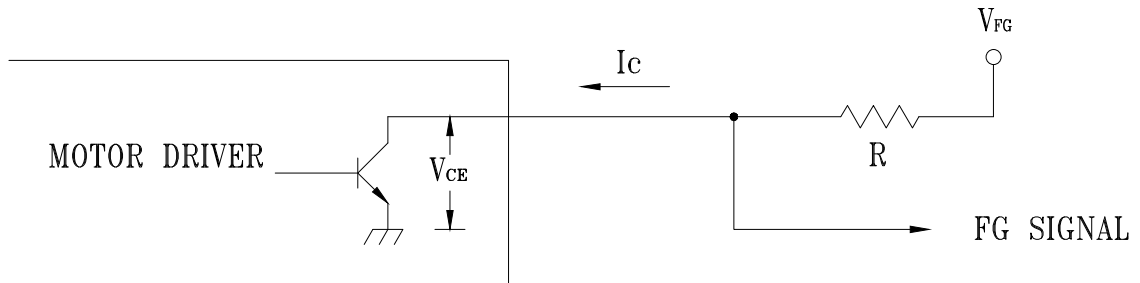

CAUTION:


THE LEAD WIRE OF FG SIGNAL CAN NOT TOUCH
THE LEAD WIRE OF POSITIVE OR NEGATIVE.

11-2. SPECIFICATION:

$V_{FG} = 12.6V \text{ MAX.}$ $I_c = 5mA \text{ MAX.}$

$V_{CE} = 0.5V \text{ MAX.}$ $R \geq V_{FG} / I_c$

11-3. FREQUENCY GENERATOR WAVEFORM:

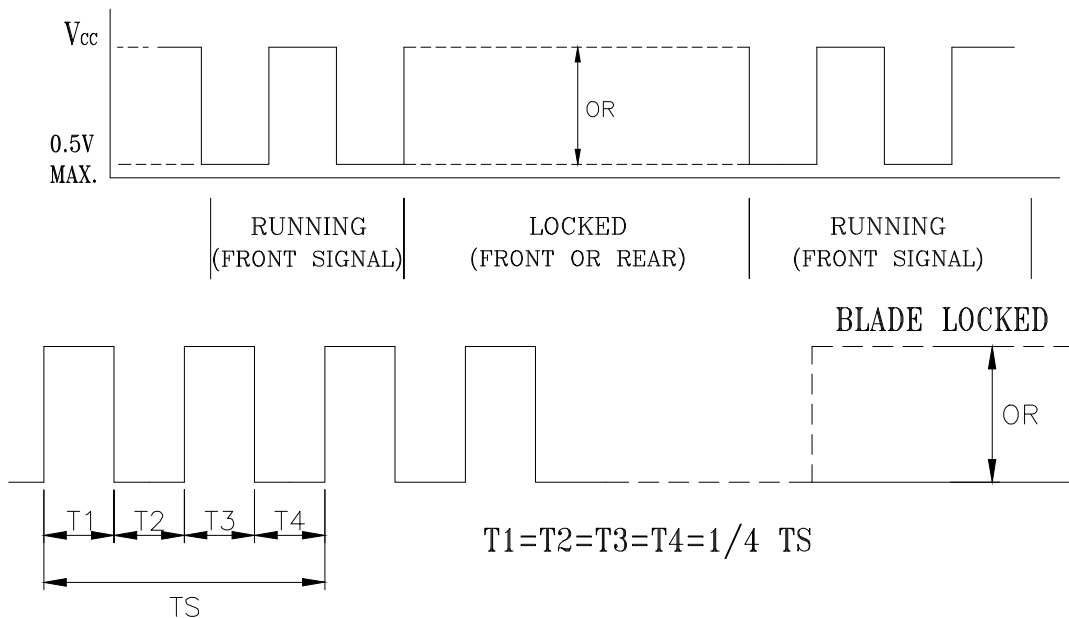

$N=R.P.M$

$T_S=60/N(\text{SEC})$

*VOLTAGE LEVEL AFTER BLADE LOCKED


*4 POLES

PART NO:

DELTA MODEL: GFC0412DS-DV17

12. ROTATION DETECT (RD) SIGNAL (REAR FAN):

12-1. OUTPUT CIRCUIT - OPEN COLLECTOR MODE:

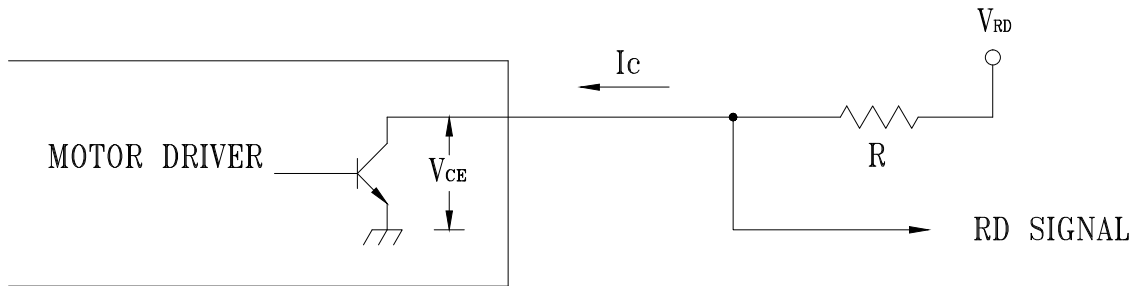

CAUTION:

THE LEAD WIRE OF RD SIGNAL CAN NOT TOUCH
THE LEAD WIRE OF POSITIVE OR NEGATIVE.

12-2. SPECIFICATION:

$V_{RD} = 12.6V \text{ MAX.}$ $I_c = 5mA \text{ MAX.}$

$V_{CE} = 0.5V \text{ MAX.}$ $R \geq V_{RD} / I_c$

12-3. FREQUENCY GENERATOR WAVEFORM:




PART NO:

DELTA MODEL: GFC0412DS-DV17

13. PWM CONTROL SIGNAL:

SIGNAL VOLTAGE RANGE: 0~15VDC

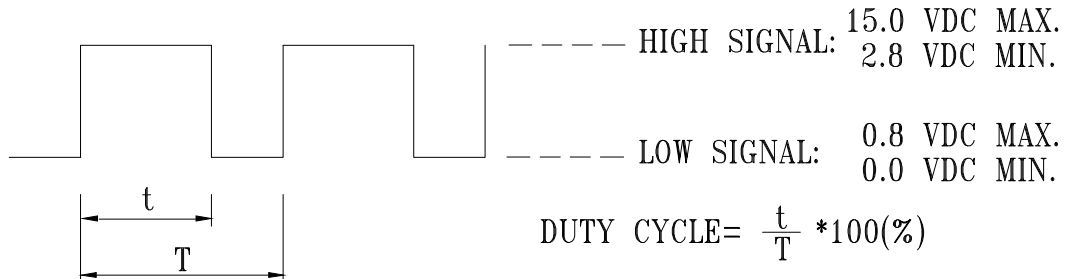


- THE PREFERRED OPERATING POINT FOR THE FAN IS 25KHZ.
- AT 100% DUTY CYCLE,THE ROTOR WILL SPIN AT MAXIMUM SPEED.
- AT 0% DUTY CYCLE,THE ROTOR WILL SPIN AT MINIMUM SPEED.
- WITH CONTROL SIGNAL LEAD DISCONNECTED,THE FAN WILL SPIN AT MAXIMUM SPEED.
- AT 25KHZ 30% DUTY CYCLE ,THE FAN WILL BE ABLE TO START FROM A DEAD STOP .

14. SPEED VS PWM CONTROL SIGNAL:

(AT RATED VOLTAGE & PWM FREQUENCY=25KHZ)

DUTY CYCLE (%)	SPEED R.P.M. (REF.)		CURRENT (A) TYP. TOTAL
	FRONT	REAR	
100	20500±10%	17600±10%	1.50
0	1500±450	1500±450	0.05

15. PWM CONTROL LEAD WIRE INPUT IMPEDANCE:

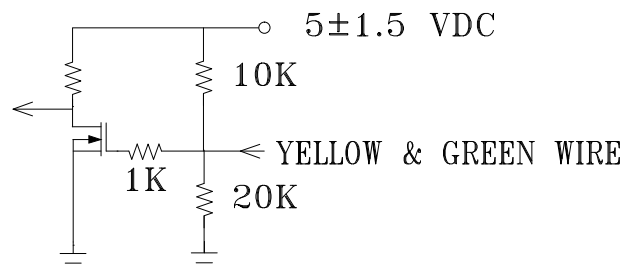

15-1. THE FAN SPEED WILL DEFAULT TO MAXIMUM WHEN THE SPEED CONTROL INPUT IS LEFT UNCONNECTED.



Application Notice

- 1. Delta will not guarantee the performance of the products if the application condition falls outside the parameters set forth in the specification.**
- 2. A written request should be submitted to Delta prior to approval if deviation from this specification is required.**
- 3. Please exercise caution when handling fans. Damage may be caused when pressure is applied to the impeller, if the fans are handled by the lead wires, or if the fan was hard-dropped to the production floor.**
- 4. Except as pertains to some special designs, there is no guarantee that the products will be free from any such safety problems or failures as caused by the introduction of powder, droplets of water or encroachment of insect into the hub.**
- 5. The above-mentioned conditions are representative of some unique examples and viewed as the first point of reference prior to all other information.**
- 6. It is very important to establish the correct polarity before connecting the fan to the power source. Positive (+) and Negative (-). Damage may be caused to the fans if connection is with reverse polarity, if there is no foolproof method to protect against such error specifically mentioned in this spec.**
- 7. Delta fans without special protection are not suitable where any corrosive fluids are introduced to their environment.**
- 8. Please ensure all fans are stored according to the storage temperature limits specified. Do not store fans in a high humidity environment. We highly recommend performance testing is conducted before shipping, if the fans have been stored over 6 months.**
- 9. Not all fans are provided with the Lock Rotor Protection feature. If you impair the rotation of the impeller for the fans that do not have this function, the performance of those fans will lead to failure.**
- 10. Please be cautious when mounting the fan. Incorrect mounting of fans may cause excess resonance, vibration and subsequent noise.**
- 11. It is important to consider safety when testing the fans. A suitable fan guard should be fitted to the fan to guard against any potential for personal injury.**
- 12. Except where specifically stated, all tests are carried out at room (ambient) temperature and relative humidity conditions of 25°C, 65% RH. The test value is only for fan performance itself.**
- 13. Be certain to connect an “ 4.7μF or greater” capacitor to the fan externally when the application calls for using multiple fans in parallel, to avoid any unstable power.**