

AC axial fan

sickled blades (S series)

A2E250-AQ32-07 ebmpapst Datasheet
sales@fansco.com
www.fansco.com

Nominal data

Type	A2E250-AQ32-07			
Motor	M2E068-DF			
Phase		1~	1~	1~
Nominal voltage	VAC	115	115	115
Frequency	Hz	50	60	60
Type of data definition		ml	ml	ml
Valid for approval / standard		CE	CE	UL 2111
Speed (rpm)	min ⁻¹	2550	2700	2700
Power input	W	135	190	196
Current draw	A	1.18	1.67	1.71
Motor capacitor	μF	14	14	14
Capacitor voltage	VDB	220	220	220
Max. back pressure	Pa	140	160	160
Min. ambient temperature	°C	-25	-25	-25
Max. ambient temperature	°C	65	50	50

ml = Max. load · me = Max. efficiency · fa = Running at free air · cs = Customer specs · cu = Customer unit
Subject to alterations



AC axial fan


sickled blades (S series)

Technical features

Mass	2.1 kg
Size	250 mm
Surface of rotor	Coated in black
Material of blades	PP plastic
Number of blades	7
Direction of air flow	"V"
Direction of rotation	Counter-clockwise, seen on rotor
Type of protection	IP 44; Depending on installation and position as per EN 60034-5
Insulation class	"F"
Humidity (F)/environmental protection class (H)	H0+
Max. permissible ambient motor temp. (transp./ storage)	+ 80 °C
Min. permissible ambient motor temp. (transp./storage)	- 40 °C
Mounting position	Shaft horizontal or rotor on top; rotor on bottom on request
Condensate discharge holes	On the stator side
Operation mode	S1
Motor bearing	Ball bearing
Touch current acc. IEC 60990 (measuring network Fig. 4, TN system)	< 0.75 mA
Motor protection	Thermal overload protector (TOP) wired internally
Cable exit	Variable
Protection class	I (if protective earth is connected by customer)
Product conforming to standard	EN 60335-1; CE
Approval	UL 2111; CSA C22.2 No.77




Product drawing

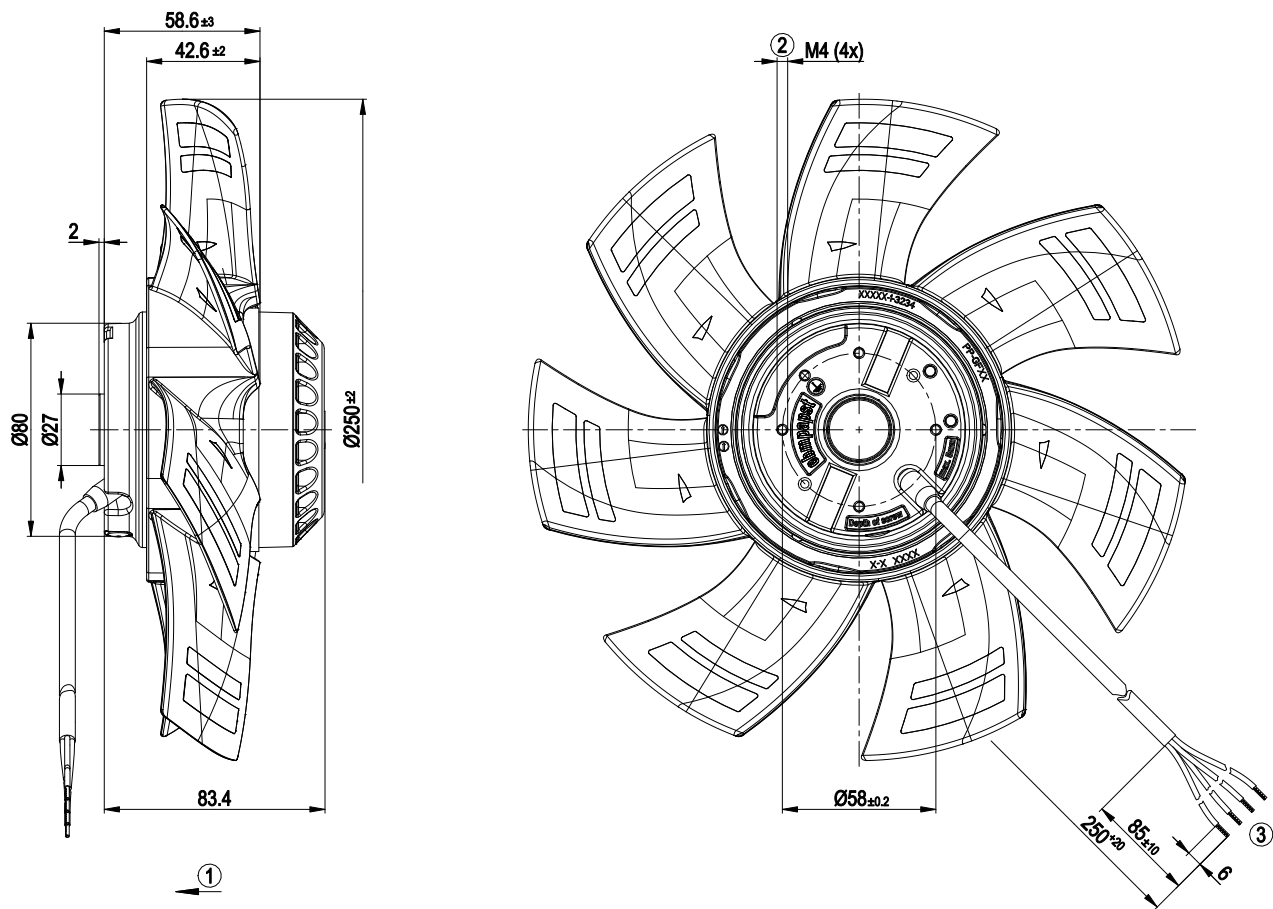

- | | |
|---|--|
| 1 | Direction of air flow "V" |
| 2 | Thread reach max. 5 mm |
| 3 | Connection line PFA AWG20 (green/yellow AWG18), 4x lead tips crimped |

Connection screen

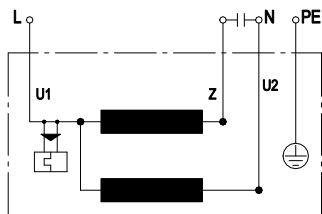


U1	blue	Z	brown	U2	black
PE	green/yellow				



AC axial fan
sickled blades (S series)

Charts: Air flow 50 Hz

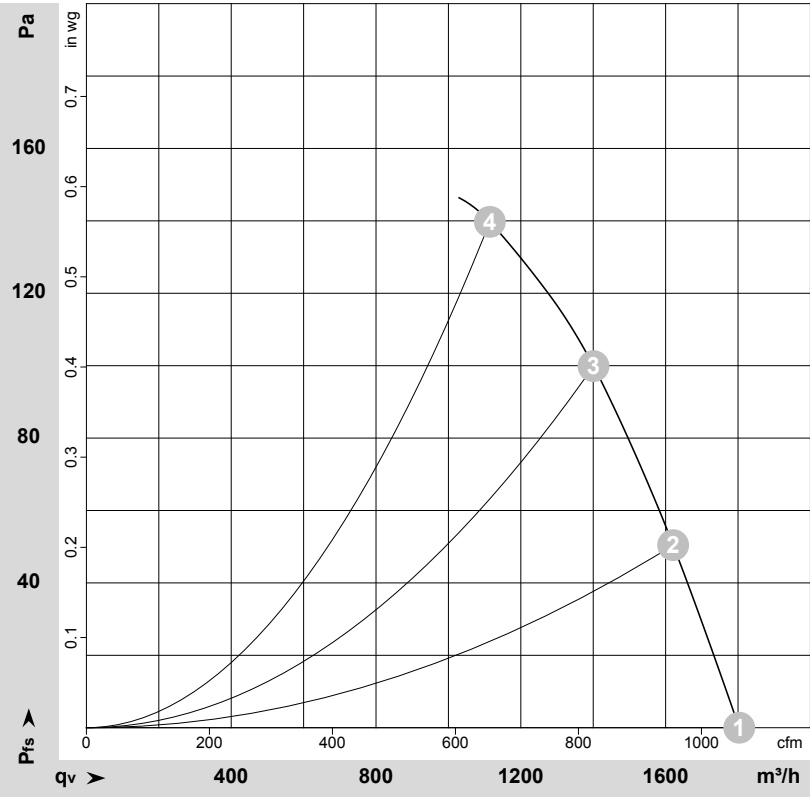

$\rho = 1.15 \text{ kg/m}^3 \pm 2 \%$

Measurement: LU-168583-1

Air performance measured as per ISO 5801 Installation category A. For detailed information on the measuring set-up, please contact ebmpapst. Suction-side noise levels: L_{WA} measured as per ISO 13347 / L_{pA} measured with 1m distance to fan axis. The values given are valid under the measuring conditions mentioned above and may vary according to the actual installation situation. With any deviation from the standard set-up, the specific values have to be checked and reviewed with the unit installed.

Measured values


	U	f	n	P _e	I	q _v	p _{fs}	q _v	p _{fs}
	V	Hz	min ⁻¹	W	A	m ³ /h	Pa	cfm	inH ₂ O
1	115	50	2690	111	0.97	1805	0	1060	0.00
2	115	50	2635	121	1.05	1620	50	955	0.20
3	115	50	2580	129	1.13	1400	100	825	0.40
4	115	50	2550	135	1.18	1115	140	655	0.56

U = Supply voltage · f = Frequency · n = Speed (rpm) · P_e = Power input · I = Current draw · q_v = Air flow · p_{fs} = Pressure increase



AC axial fan
sickled blades (S series)

Charts: Air flow 60 Hz

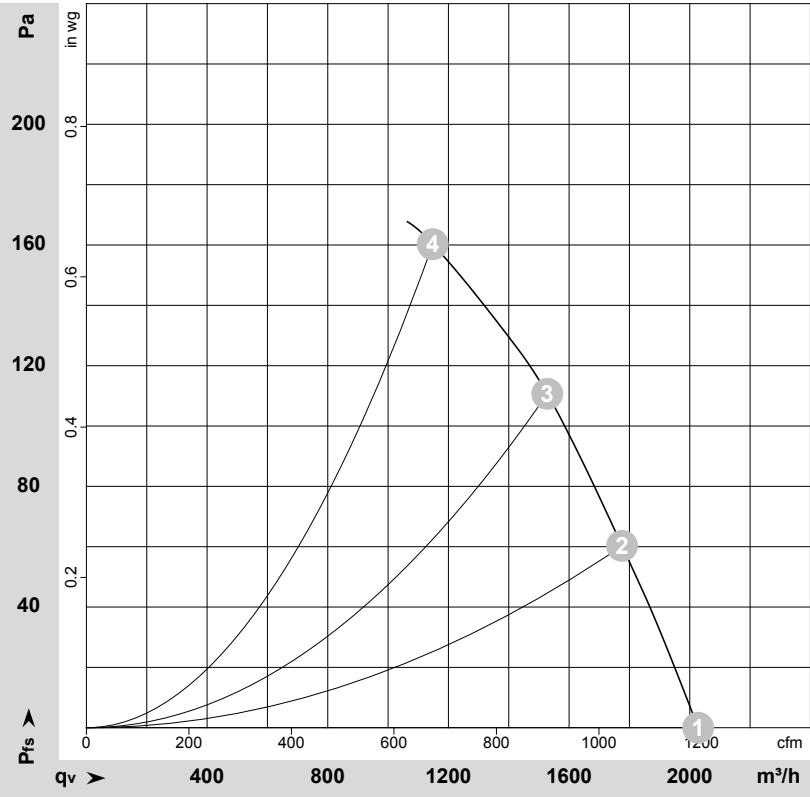

$\rho = 1.15 \text{ kg/m}^3 \pm 2 \%$

Measurement: LU-168407-1

Air performance measured as per ISO 5801 Installation category A. For detailed information on the measuring set-up, please contact ebm-papst. Suction-side noise levels: LwA measured as per ISO 13347 / LpA measured with 1m distance to fan axis. The values given are valid under the measuring conditions mentioned above and may vary according to the actual installation situation. With any deviation from the standard set-up, the specific values have to be checked and reviewed with the unit installed.

Measured values

	U	f	n	P _e	I	q _v	p _{fs}	q _v	p _{fs}
	V	Hz	min ⁻¹	W	A	m ³ /h	Pa	cfm	inH ₂ O
1	115	60	3015	166	1.47	2030	0	1195	0.00
2	115	60	2885	178	1.55	1775	60	1045	0.24
3	115	60	2775	184	1.61	1530	110	900	0.44
4	115	60	2700	190	1.67	1150	160	675	0.64

U = Supply voltage · f = Frequency · n = Speed (rpm) · P_e = Power input · I = Current draw · q_v = Air flow · p_{fs} = Pressure increase

