

AC axial fan

sickled blades (S series)

A4E300-AP26-31 ebmpapst Datasheet
sales@fansco.com
www.fansco.com



AC axial fan

sickled blades (S series)

Technical features


Size	300 mm
Surface of rotor	Coated in black
Material of blades	Sheet steel, coated in black
Number of blades	7
Direction of air flow	"A"
Direction of rotation	Clockwise, seen on rotor
Type of protection	IP 44
Insulation class	"B"
Humidity class	F1-2
Max. permissible ambient motor temp. (transp./ storage)	+ 80 °C
Min. permissible ambient motor temp. (transp./storage)	- 40 °C
Mounting position	Shaft horizontal or rotor on bottom; rotor on top on request
Condensate discharge holes	Rotor-side
Operation mode	S1
Motor bearing	Ball bearing
Leakage current	< 0.75 mA
Motor protection	Thermal overload protector (TOP) wired internally
Cable exit	Variable
Protection class	I (if protective earth is connected by customer)
Product conforming to standard	EN 60335-1; CE



AC axial fan


sickled blades (S series)

Product drawing

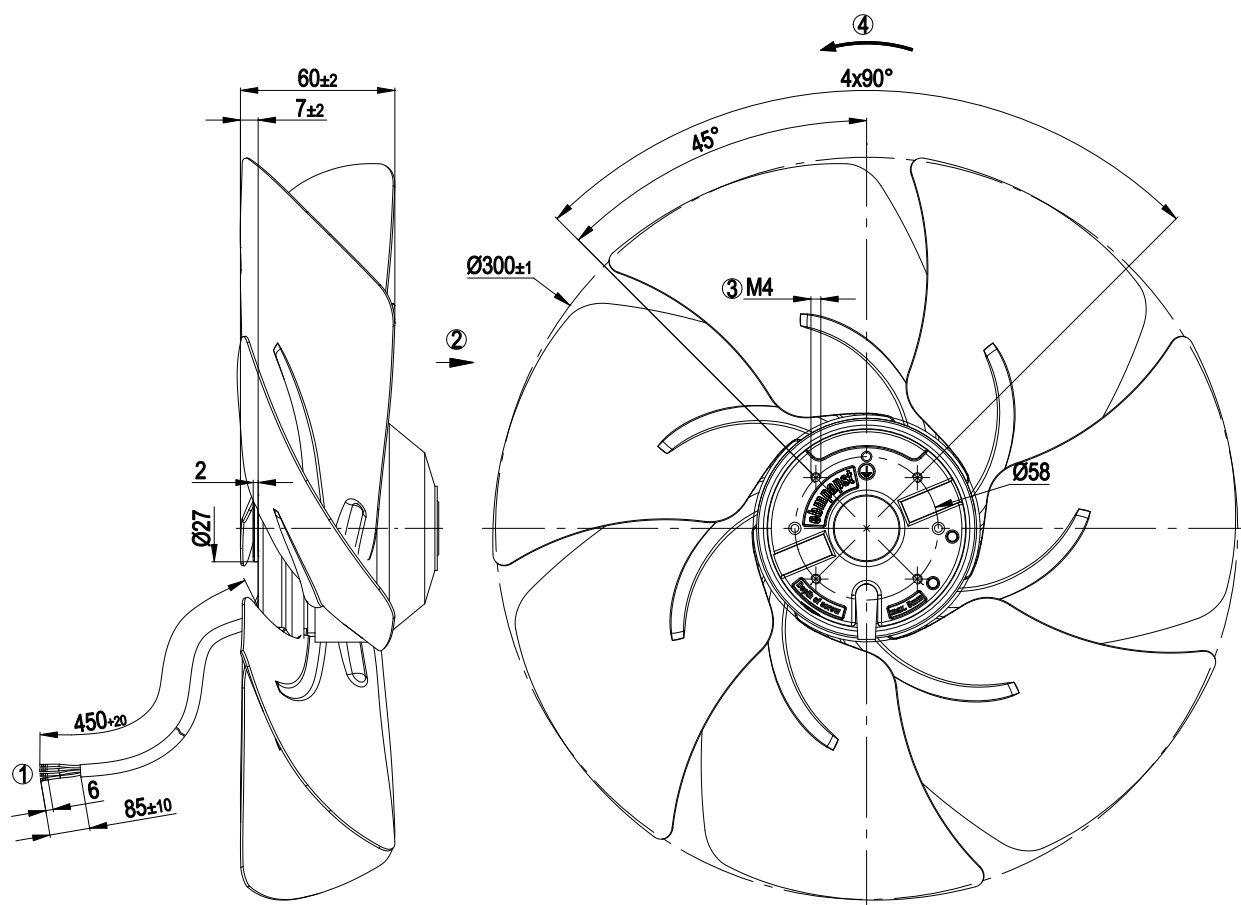

1	Connection line PVC, 4x brass lead tips crimped
2	Direction of air flow "A"
3	Depth of screw max. 5 mm
4	Direction of rotation clockwise, seen on rotor

Connection screen

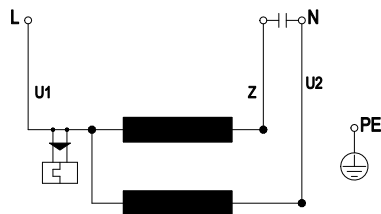


U1	blue	Z	brown	U2	black
PE	green/yellow				



AC axial fan

sickled blades (S series)

Charts: Air flow 50 Hz

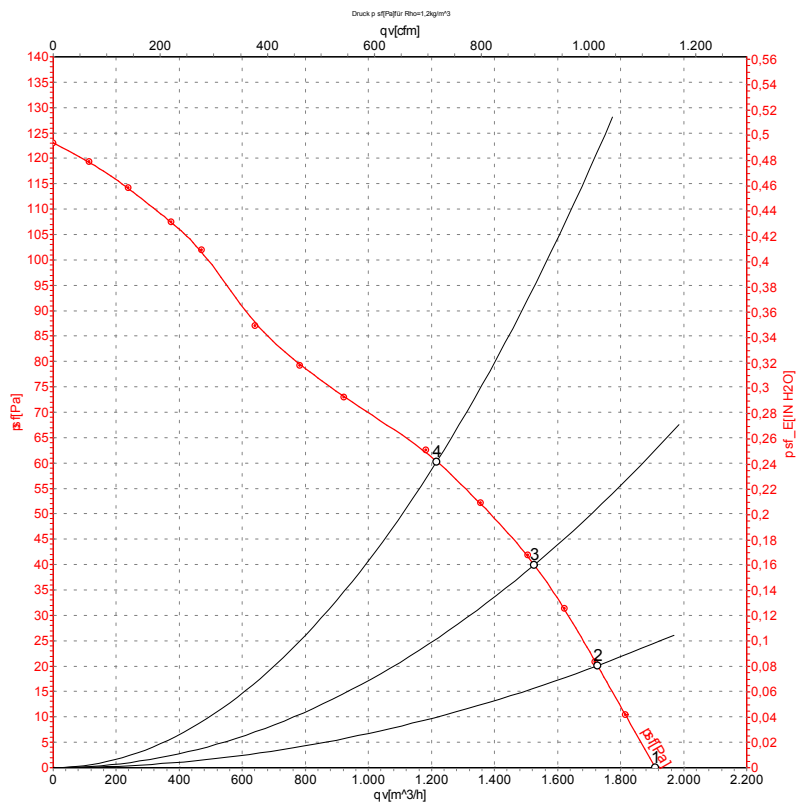

Measurement: LU-31732


Air performance measured as per ISO 5801
Installation category A. For detailed
information on the measuring set-up, please
contact ebm-papst. Suction-side noise
levels: L_{wA} measured as per ISO 13347 /
L_{pA} measured with 1m distance to fan axis.
The values given are valid under the
measuring conditions mentioned above and
may vary according to the actual installation
situation. With any deviation from the
standard set-up, the specific values have to
be checked and reviewed with the unit
installed.

Measured values

	U	f	n	P _e	I	qv	p _{sf}
	V	Hz	min ⁻¹	W	A	m³/h	Pa
1	230	50	1400	70	0.32	1910	0
2	230	50	1380	74	0.33	1725	20
3	230	50	1365	77	0.34	1525	40
4	230	50	1330	82	0.36	1215	60



Charts: Air flow 60 Hz

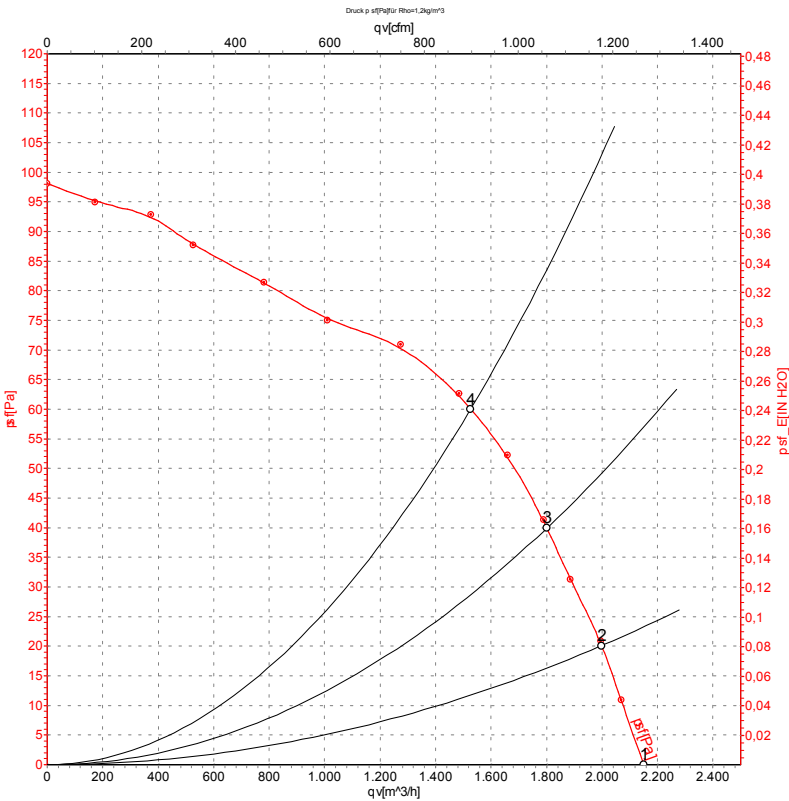

Measurement: LU-31733

Air performance measured as per ISO 5801
Installation category A. For detailed
information on the measuring set-up, please
contact ebm-papst. Suction-side noise
levels: L_{WA} measured as per ISO 13347 /
L_{pA} measured with 1m distance to fan axis.
The values given are valid under the
measuring conditions mentioned above and
may vary according to the actual installation
situation. With any deviation from the
standard set-up, the specific values have to
be checked and reviewed with the unit
installed.

Measured values

	U	f	n	P _e	I	qV	p _{sf}
	V	Hz	min ⁻¹	W	A	m³/h	Pa
1	230	60	1610	94	0.41	2150	0
2	230	60	1575	101	0.44	2000	20
3	230	60	1545	105	0.45	1800	40
4	230	60	1490	109	0.47	1525	60

