

A6E500-BB05-01 ebmpapst Datasheet
 sales@fansco.com
 www.fansco.com

Limited partnership · Headquarters Muldingen
 County court Stuttgart · HRA 590344

General partner Elektrobau Muldingen GmbH · Headquarters Muldingen
 County court Stuttgart · HRB 590142



Nominal data

| | | | |
|-------------------------------|-------------------|---------|---------|
| Type | A6E500-BB05-01 | | |
| Motor | M6E094-FA | | |
| Phase | | 1~ | 1~ |
| Nominal voltage | VAC | 230 | 230 |
| Frequency | Hz | 50 | 60 |
| Type of data definition | | ml | ml |
| Valid for approval / standard | | CE | CE |
| Speed | min ⁻¹ | 845 | 875 |
| Power input | W | 220 | 290 |
| Current draw | A | 0.98 | 1.27 |
| Motor capacitor | µF | 6 | 6 |
| Capacitor voltage | VDB | 400 | 400 |
| Capacitor standard | | P0 (CE) | P0 (CE) |
| Max. back pressure | Pa | 60 | 60 |
| Min. ambient temperature | °C | -40 | -40 |
| Max. ambient temperature | °C | 95 | 80 |
| Starting current | A | 1.65 | |

ml = max. load · me = max. efficiency · fa = running at free air · cs = customer specs · cu = customer unit
 Subject to alterations

Data according to ErP directive

| | |
|-----------------------|--------|
| Installation category | A |
| Efficiency category | Static |
| Variable speed drive | No |
| Specific ratio* | 1.00 |

* Specific ratio = $1 + p_b / 100\,000\text{ Pa}$

| | Actual | Request 2013 | Request 2015 |
|--------------------------------|-------------------|--------------|--------------|
| Overall efficiency η_{es} | 29.4 | 25.4 | 29.4 |
| Efficiency grade N | 40 | 36 | 40 |
| Power input P_e | kW | 0.21 | |
| Air flow q_v | m ³ /h | 3770 | |
| Pressure increase p_{fs} | Pa | 60 | |
| Speed n | min ⁻¹ | 850 | |

Data established at point of optimum efficiency



AC axial fan


sickled blades (S series)

Technical features

| | |
|---|---|
| Size | 500 mm |
| Surface of rotor | Coated in black |
| Material of terminal box | ABS plastic, black |
| Material of blades | Sheet steel, coated in black |
| Number of blades | 5 |
| Direction of air flow | "V" |
| Direction of rotation | Counter-clockwise, seen on rotor |
| Type of protection | IP 54 |
| Insulation class | "F" |
| Humidity class | F3-1 |
| Max. permissible ambient motor temp. (transp./ storage) | + 80 °C |
| Min. permissible ambient motor temp. (transp./storage) | - 40 °C |
| Mounting position | Shaft horizontal or rotor on bottom; rotor on top on request |
| Condensate discharge holes | Rotor-side |
| Operation mode | S1 |
| Motor bearing | Ball bearing |
| Touch current acc. IEC 60990 (measuring network Fig. 4, TN system) | <= 3.5 mA |
| Electrical leads | Via terminal box, integrated capacitor connected via terminal box |
| Motor protection | Thermal overload protector (TOP) brought out |
| Protection class | I (if protective earth is connected by customer) |
| Product conforming to standard | EN 60034-1 (2004) |




Product drawing

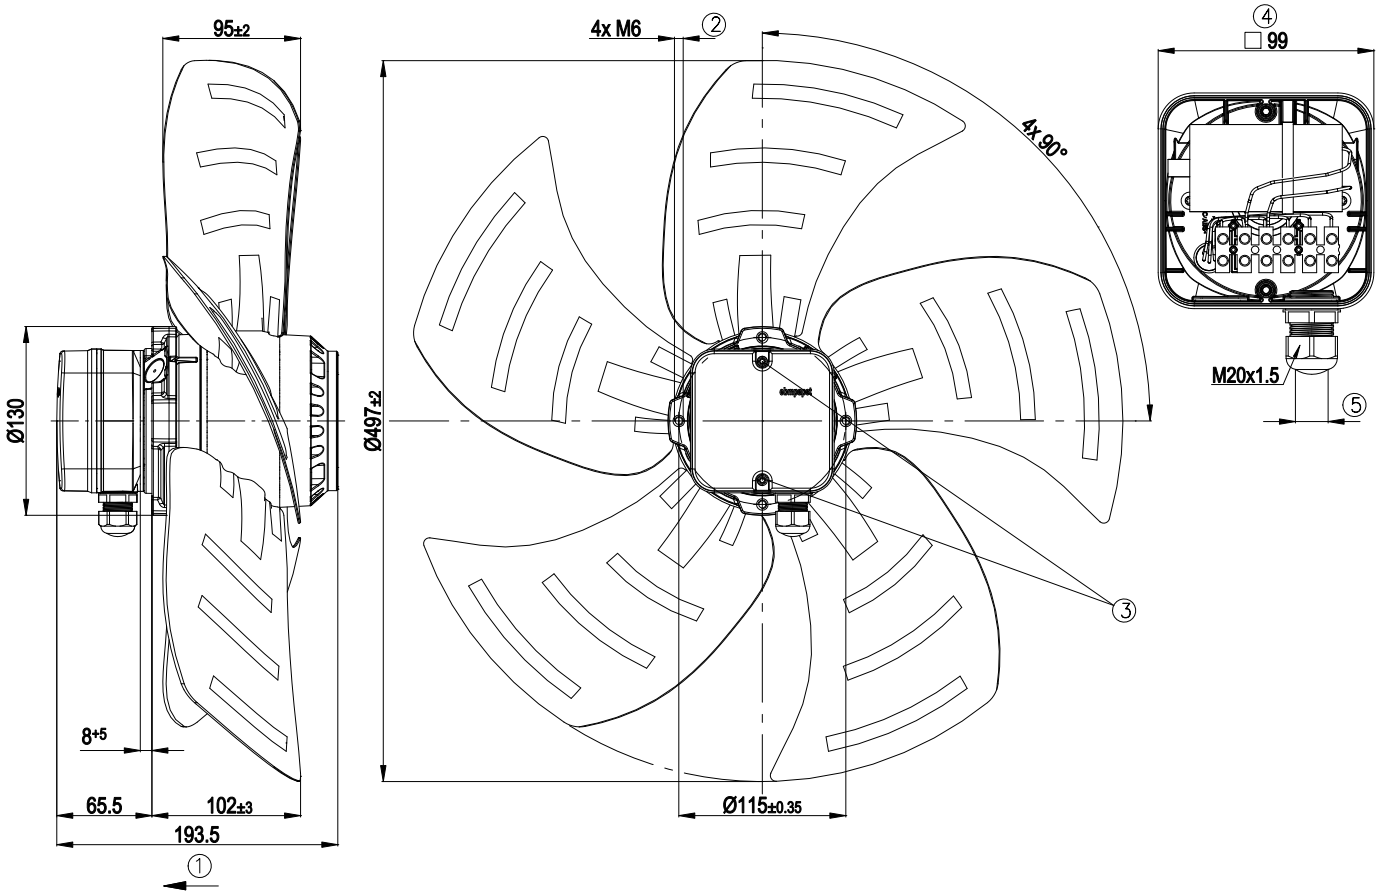

| | |
|---|--|
| 1 | Direction of air flow "V" |
| 2 | Screw depth max. 12 mm |
| 3 | Tightening torque 0.8 Nm±0.15 Nm |
| 4 | Shown without terminal box cover |
| 5 | Cable diameter: min. 6 mm, max. 12 mm; tightening torque: 2 Nm ±0.3 Nm |




Connection screen



| | | | | | |
|----|----------------|-----|-------|---|--------------|
| L | = U1 = blue | Z | brown | N | = U2 = black |
| PE | green / yellow | TOP | grey | | |

Charts: Air flow 50 Hz

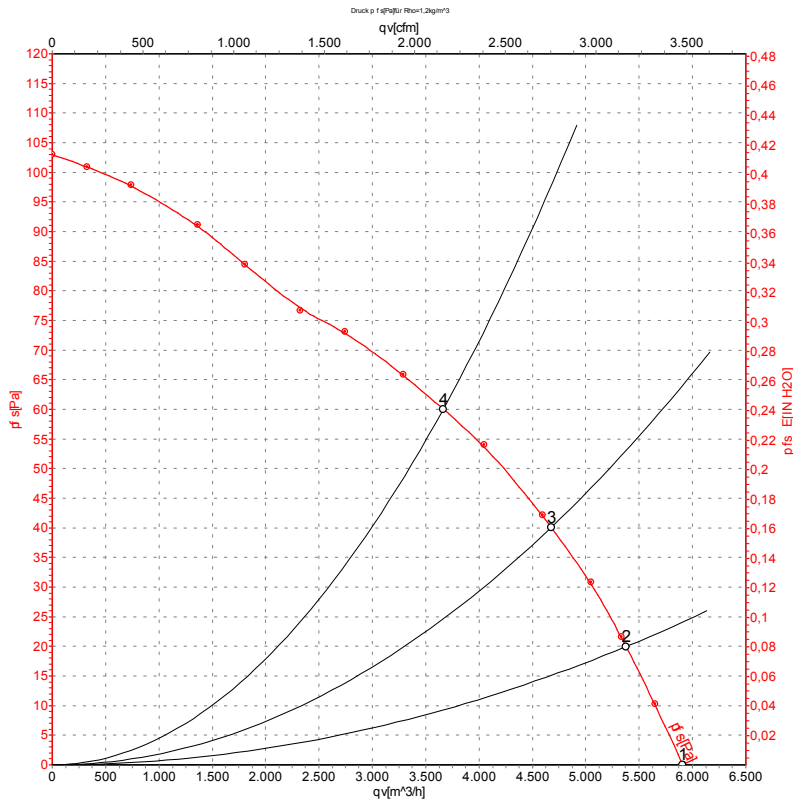

Measurement: LU-52337

Air performance measured as per ISO 5801 Installation category A. For detailed information on the measuring set-up, please contact ebm-papst. Suction-side noise levels: L_{WA} measured as per ISO 13347 / L_{pA} measured with 1m distance to fan axis. The values given are valid under the measuring conditions mentioned above and may vary according to the actual installation situation. With any deviation from the standard set-up, the specific values have to be checked and reviewed with the unit installed.


Measured values

| | U | f | n | P _e | I | qv | P _{fs} |
|---|-----|----|-------------------|----------------|------|-------------------|-----------------|
| | V | Hz | min ⁻¹ | W | A | m ³ /h | Pa |
| 1 | 230 | 50 | 895 | 190 | 0.84 | 5900 | 0 |
| 2 | 230 | 50 | 880 | 199 | 0.88 | 5375 | 20 |
| 3 | 230 | 50 | 865 | 211 | 0.93 | 4675 | 40 |
| 4 | 230 | 50 | 845 | 220 | 0.98 | 3665 | 60 |

U = Supply voltage · f = Frequency · n = Speed · P_e = Power input · I = Current draw · qv = Air flow · p_{fs} = Pressure increase



Charts: Air flow 60 Hz

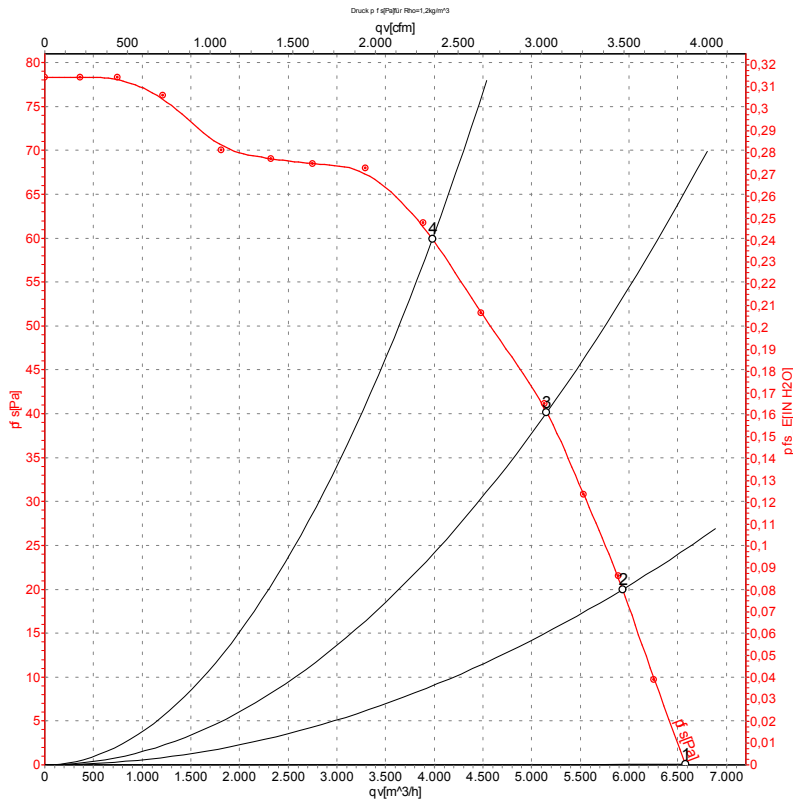

Measurement: LU-52336

Air performance measured as per ISO 5801 Installation category A. For detailed information on the measuring set-up, please contact ebmpapst. Suction-side noise levels: L_{WA} measured as per ISO 13347 / L_{pA} measured with 1m distance to fan axis. The values given are valid under the measuring conditions mentioned above and may vary according to the actual installation situation. With any deviation from the standard set-up, the specific values have to be checked and reviewed with the unit installed.

Measured values

| | U | f | n | P _e | I | qv | P _{fs} |
|---|-----|----|-------------------|----------------|------|-------------------|-----------------|
| | V | Hz | min ⁻¹ | W | A | m ³ /h | Pa |
| 1 | 230 | 60 | 995 | 267 | 1.16 | 6580 | 0 |
| 2 | 230 | 60 | 960 | 277 | 1.20 | 5935 | 20 |
| 3 | 230 | 60 | 925 | 284 | 1.23 | 5155 | 40 |
| 4 | 230 | 60 | 875 | 290 | 1.27 | 3980 | 60 |

U = Supply voltage · f = Frequency · n = Speed · P_e = Power input · I = Current draw · qv = Air flow · P_{fs} = Pressure increase

