

AC hot-air circulation blower

single inlet

with housing and angle bracket

G2E180-GV82-09 ebmpapst Datasheet

sales@fansco.com

www.fansco.com

Limited partnership · Headquarters Mulfingen
County court Stuttgart · HRA 590344

General partner Elektrobau Mulfingen GmbH · Headquarters Mulfingen
County court Stuttgart · HRB 590142

Nominal data

| | | |
|-------------------------------|-------------------|---------|
| Type | G2E180-GV82-09 | |
| Motor | M2E068-CF | |
| Phase | | 1~ |
| Nominal voltage | VAC | 230 |
| Frequency | Hz | 50 |
| Type of data definition | | fa |
| Valid for approval / standard | | CE |
| Speed (rpm) | min ⁻¹ | 2580 |
| Power input | W | 64 |
| Current draw | A | 0.28 |
| Motor capacitor | µF | 2 |
| Capacitor voltage | VDB | 400 |
| Capacitor standard | | S0 (CE) |
| Min. back pressure | Pa | 0 |
| Min. ambient temperature | °C | -25 |
| Max. ambient temperature | °C | 55 |

ml = Max. load · me = Max. efficiency · fa = Running at free air · cs = Customer specs · cu = Customer unit
Subject to alterations



Technical features


| | |
|---|---|
| Mass | 3.4 kg |
| Size | 180 mm |
| Surface of rotor | Uncoated |
| Material of impeller | Sheet steel, rust-resistant |
| Housing material | Sheet steel, galvanised |
| Number of blades | 6 |
| Motor suspension | Motor anti-vibration mounted on one side |
| Direction of rotation | Clockwise, seen on rotor |
| Type of protection | IP 44; Depending on installation and position |
| Insulation class | "F" |
| Humidity (F)/environmental protection class (H) | H0 - dry environment |
| Max. permissible ambient motor temp. (transp./ storage) | + 80 °C |
| Min. permissible ambient motor temp. (transp./storage) | - 40 °C |
| Mounting position | Any |
| Condensate discharge holes | None |
| Motor bearing | Ball bearing |
| Touch current acc. IEC 60990 (measuring network Fig. 4, TN system) | < 0.75 mA |
| Electrical leads | Via terminal box, integrated capacitor connected via terminal box |
| Motor protection | Thermal overload protector (TOP) wired internally |
| Cable exit | Variable |
| Protection class | I (if protective earth is connected by customer) |
| Motor capacitor according to EN 60252-1 in safety protection class | S0 |
| Product conforming to standard | EN 60335-1; CE |

AC hot-air circulation blower

single inlet

with housing and angle bracket


Product drawing

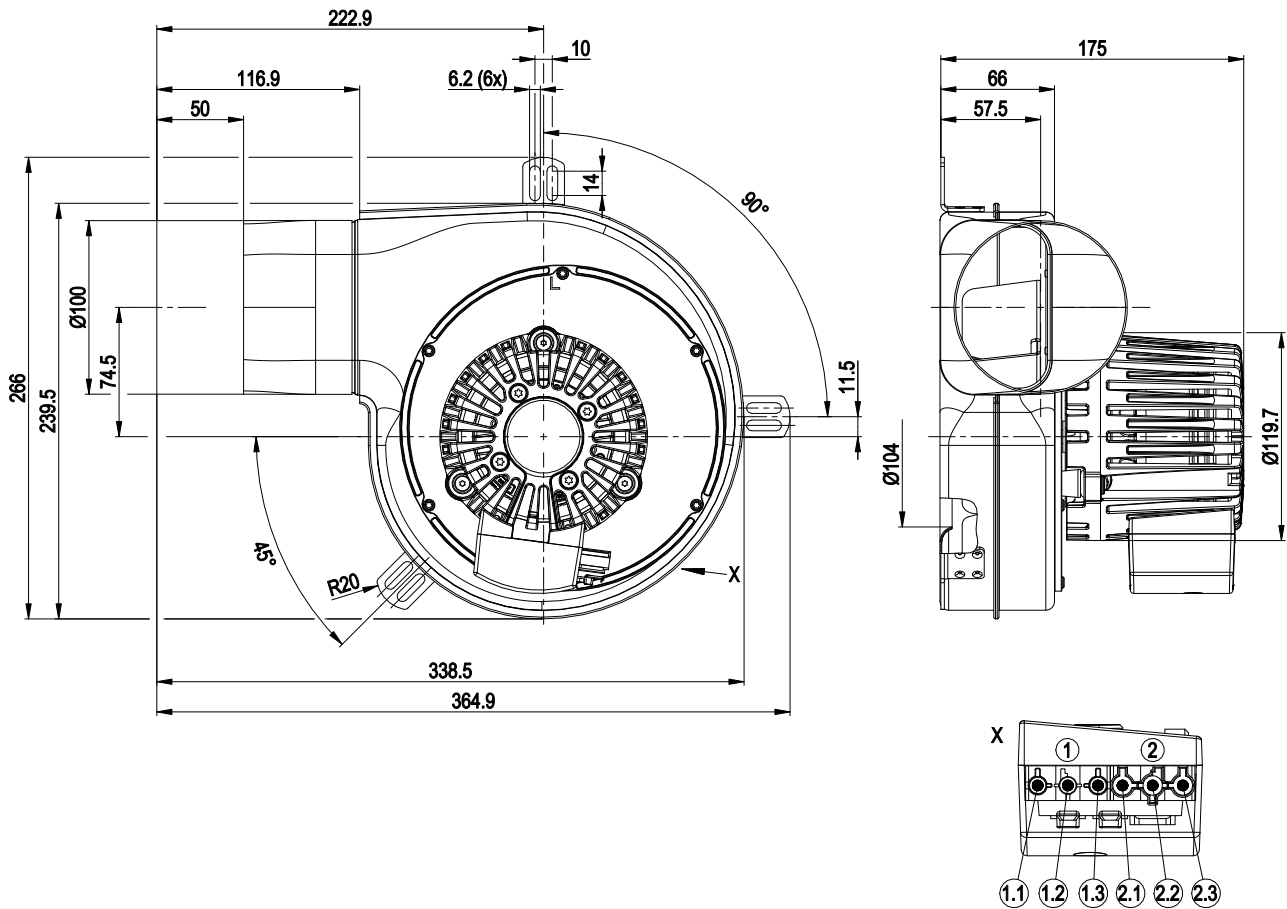

| | |
|-----|--|
| 1 | Connector housing 3-pole Wieland 93.032.3357.0 |
| 1.1 | black |
| 1.2 | green/yellow |
| 1.3 | blue |
| 2 | Connector housing 3-pole Wieland 93.031.3257.0 |
| 2.1 | black (Hall IC) |
| 2.2 | red (Hall IC) |
| 2.3 | white (Hall IC) |




Connection screen

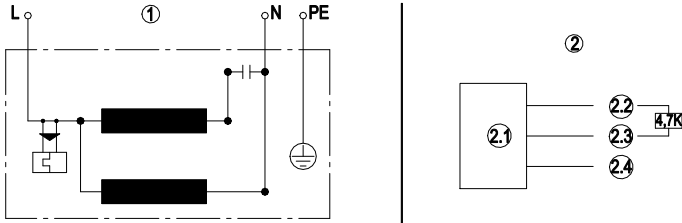

| | |
|-----|------------------------|
| 1 | Fan connection diagram |
| L | blue |
| N | black |
| PE | green/yellow |
| 2 | Hall IC circuit |
| 2.1 | Hall IC |
| 2.2 | Red (+5V) |
| 2.3 | White (out) |
| 2.4 | Black (0V) |

Charts: Air flow 50 Hz

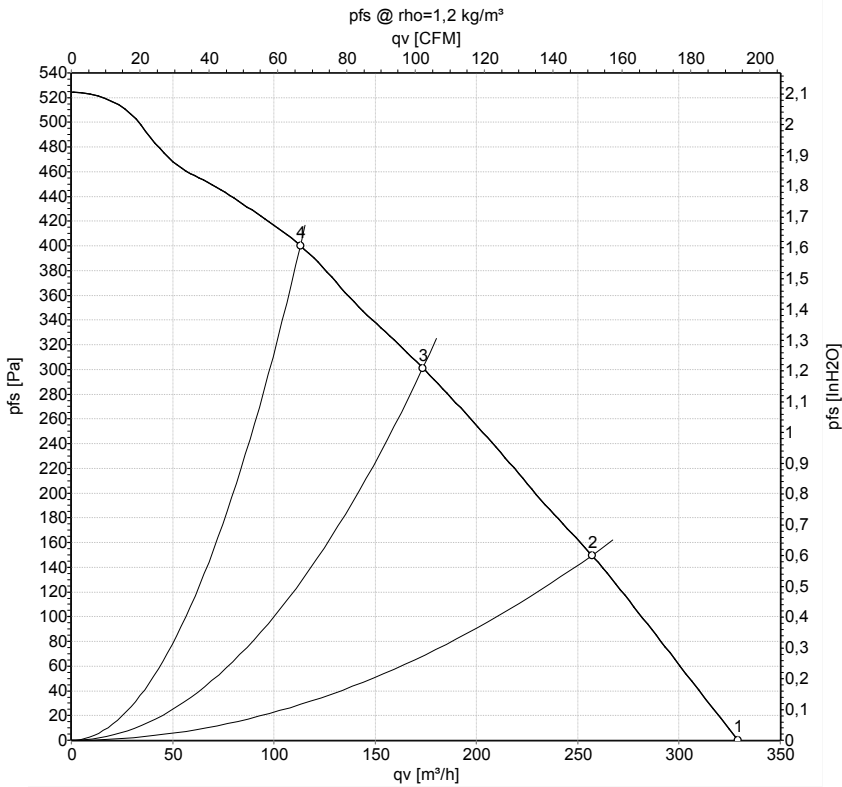

Measurement: LU-166512-1

Air performance measured as per ISO 5801 Installation category A. For detailed information on the measuring set-up, please contact ebm-papst. Suction-side noise levels: LwA measured as per ISO 13347 / LpA measured with 1m distance to fan axis. The values given are valid under the measuring conditions mentioned above and may vary according to the actual installation situation. With any deviation from the standard set-up, the specific values have to be checked and reviewed with the unit installed.

Measured values

| | U | f | n | P _e | I | q _v | p _{fs} | q _v | p _{fs} |
|---|-----|----|-------------------|----------------|------|-------------------|-----------------|----------------|-----------------|
| | V | Hz | min ⁻¹ | W | A | m ³ /h | Pa | cfm | inH2O |
| 1 | 230 | 50 | 2580 | 64 | 0.28 | 330 | 0 | 195 | 0.00 |
| 2 | 230 | 50 | 2610 | 62 | 0.27 | 255 | 150 | 150 | 0.60 |
| 3 | 230 | 50 | 2670 | 57 | 0.26 | 175 | 300 | 100 | 1.20 |
| 4 | 230 | 50 | 2740 | 51 | 0.23 | 115 | 400 | 65 | 1.61 |

U = Supply voltage · f = Frequency · n = Speed (rpm) · P_e = Power input · I = Current draw · q_v = Air flow · p_{fs} = Pressure increase

