

AC axial fan

sickled blades (S series)
with guard grille for full nozzle

S4E400-BA06-06 ebmpapst Datasheet
sales@fansco.com
www.fansco.com

Nominal data

Type	S4E400-BA06-06		
Motor	M4E068-EC		
Phase		1~	1~
Nominal voltage	VAC	230	230
Frequency	Hz	50	60
Type of data definition		fa	fa
State		prelim.	prelim.
Valid for approval / standard		CE	CE
Speed	min ⁻¹	1390	1550
Power input	W	140	195
Current draw	A	0.61	0.85
Motor capacitor	μF	5	5
Capacitor voltage	VDB	400	400
Capacitor standard		P0 (CE)	P0 (CE)
Max. back pressure	Pa	90	40
Max. ambient temperature	°C	40	30

ml = max. load · me = max. efficiency · fa = running at free air · cs = customer specs · cu = customer unit
Subject to alterations

Data according to ErP directive

Installation category	A
Efficiency category	Static
Variable speed drive	No
Specific ratio*	1.00

* Specific ratio = $1 + p_g / 100\,000\text{ Pa}$

	Actual	Request 2013	Request 2015
Overall efficiency η_{es}	30.4	25	29
Efficiency grade N	41.4	36	40
Power input P_e	kW	0.18	
Air flow q_v	m ³ /h	2475	
Pressure increase p_{fs}	Pa	80	
Speed n	min ⁻¹	1315	

Data established at point of optimum efficiency



AC axial fan

sickled blades (S series)
with guard grille for full nozzle

Technical features

Size	400 mm
Surface of rotor	Coated in black
Material of terminal box	ABS plastic, black
Material of blades	Sheet steel, coated in black
Material of guard grille	Steel, phosphated and coated in black plastic
Number of blades	5
Direction of air flow	"A"
Direction of rotation	Clockwise, seen on rotor
Type of protection	IP 44
Insulation class	"B"
Humidity class	F5
Max. permissible ambient motor temp. (transp./ storage)	+ 80 °C
Min. permissible ambient motor temp. (transp./storage)	- 40 °C
Mounting position	Shaft horizontal or rotor on bottom; rotor on top on request
Condensate discharge holes	Rotor-side
Operation mode	S1
Motor bearing	Ball bearing
Touch current acc. IEC 60990 (measuring network Fig. 4, TN system)	< 0.75 mA
Electrical leads	Via terminal box, integrated capacitor connected via terminal box
Motor protection	Thermal overload protector (TOP) wired internally
Cable exit	Axial
Protection class	I (if protective earth is connected by customer)
Product conforming to standard	EN 60335-1; CE




AC axial fan

sickled blades (S series)

with guard grille for full nozzle

Product drawing

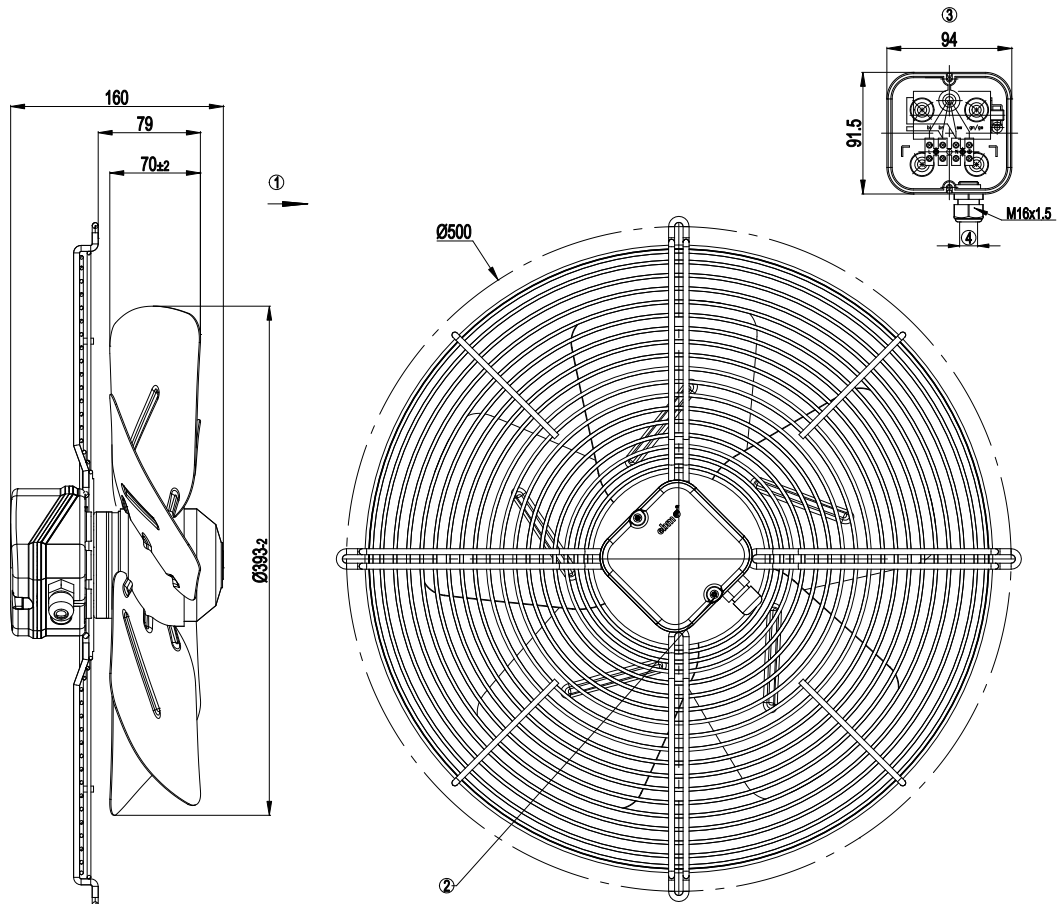


1	Direction of air flow "A"
2	Tightening torque 0.7 Nm ± 0.2 Nm
3	Illustration without terminal box cover
4	Cable diameter: max. 7.5 mm, tightening torque 1.3 Nm ± 0.2 Nm

AC axial fan

sickled blades (S series)
with guard grille for full nozzle

Connection screen

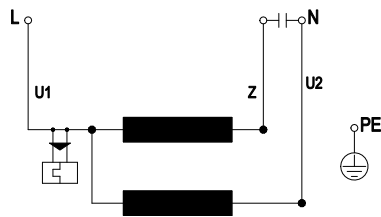


U1	blue	Z	brown	U2	black
PE	green/yellow				



AC axial fan
sickled blades (S series)
with guard grille for full nozzle

Charts: Air flow 50 Hz

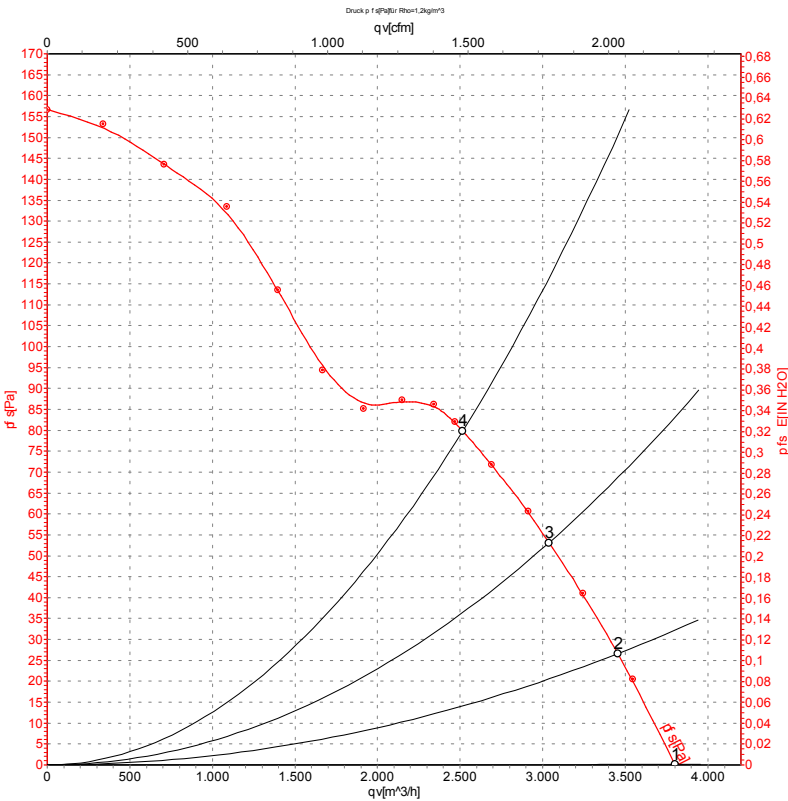

Measurement: LU-24432

Air performance measured as per ISO 5801
Installation category A. For detailed
information on the measuring set-up, please
contact ebm-papst. Suction-side noise
levels: L_{WA} measured as per ISO 13347 /
L_{pA} measured with 1m distance to fan axis.
The values given are valid under the
measuring conditions mentioned above and
may vary according to the actual installation
situation. With any deviation from the
standard set-up, the specific values have to
be checked and reviewed with the unit
installed.

Measured values


	U	f	n	P _e	I	qv	p _{fs}
	V	Hz	min ⁻¹	W	A	m³/h	Pa
1	230	50	1405	129	0.57	3800	0
2	230	50	1380	146	0.64	3455	27
3	230	50	1350	162	0.71	3040	53
4	230	50	1315	180	0.78	2515	80

U = Supply voltage · f = Frequency · n = Speed · P_e = Power input · I = Current draw · qv = Air flow · p_{fs} = Pressure increase



AC axial fan
sickled blades (S series)
with guard grille for full nozzle

Charts: Air flow 60 Hz

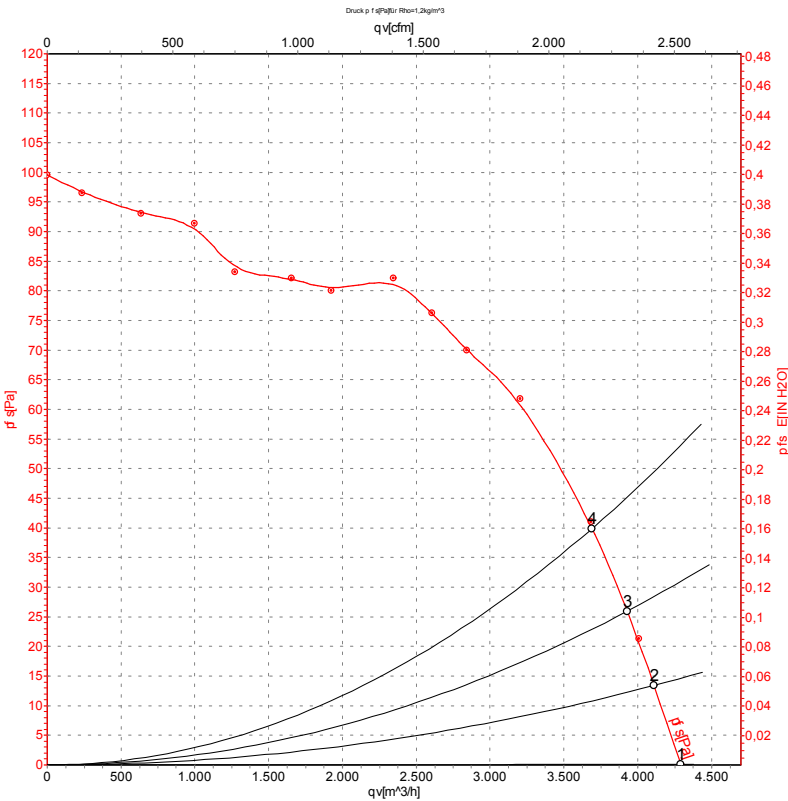

Measurement: LU-24433

Air performance measured as per ISO 5801
Installation category A. For detailed
information on the measuring set-up, please
contact ebm-papst. Suction-side noise
levels: LwA measured as per ISO 13347 /
LpA measured with 1m distance to fan axis.
The values given are valid under the
measuring conditions mentioned above and
may vary according to the actual installation
situation. With any deviation from the
standard set-up, the specific values have to
be checked and reviewed with the unit
installed.

Measured values

	U	f	n	P _e	I	qv	p _{fs}
	V	Hz	min ⁻¹	W	A	m ³ /h	Pa
1	230	60	1600	179	0.79	4290	0
2	230	60	1575	189	0.83	4110	15
3	230	60	1545	199	0.87	3930	25
4	230	60	1505	211	0.92	3690	40

U = Supply voltage · f = Frequency · n = Speed · P_e = Power input · I = Current draw · qv = Air flow · p_{fs} = Pressure increase

