

AC axial fan - HyBlade

sickled blades (S series)
with guard grille for full nozzle

S6D500-CJ05-01 ebmpapst Datasheet
sales@fansco.com
www.fansco.com

Nominal data

Type	S6D500-CJ05-01				
Motor	M6D110-EF				
Phase		3~	3~	3~	3~
Nominal voltage	VAC	400	400	480	480
Connection		Δ	Y	Δ	Y
Frequency	Hz	50	50	60	60
Type of data definition		ml	ml	ml	ml
Valid for approval / standard		CE	CE	CE	CE
Speed (rpm)	min ⁻¹	920	785	1090	880
Power input	W	260	190	410	290
Current draw	A	0.63	0.32	0.72	0.41
Max. back pressure	Pa	70	50	95	62
Min. ambient temperature	°C	-40	-40	-40	-40
Max. ambient temperature	°C	80	80	80	80
Starting current	A	2.2	0.73	2.4	0.8

ml = Max. load · me = Max. efficiency · fa = Running at free air · cs = Customer specs · cu = Customer unit
Subject to alterations

Data according to ErP directive

		Actual	Request 2015			
01 Overall efficiency η_{es}	%	29.9	29.9	09 Power input P_e	kW	0.25
02 Measurement category		A		09 Air flow q_v	m ³ /h	4105
03 Efficiency category		Static		09 Pressure increase p_{fs}	Pa	64
04 Efficiency grade N		40	40	10 Speed (rpm) n	min ⁻¹	925
05 Variable speed drive		No		11 Specific ratio*		1.00

Data definition with optimum efficiency.
The ErP data is determined using a motor-impeller combination in a standardised measurement configuration.

* Specific ratio = $1 + p_{fs} / 100\,000\text{ Pa}$

LU-140967



AC axial fan - HyBlade

sickled blades (S series)

with guard grille for full nozzle

Technical features

Mass	9.9 kg
Size	500 mm
Surface of rotor	Coated in black
Material of terminal box	PP plastic
Material of blades	Press-fitted sheet steel blank, sprayed with PP plastic
Material of guard grille	Steel, coated in black plastic (RAL9005)
Number of blades	5
Direction of air flow	"V"
Direction of rotation	Counter-clockwise, seen on rotor
Type of protection	IP 54
Insulation class	"F"
Humidity (F)/environmental protection class (H)	F4-1
Max. permissible ambient motor temp. (transp./ storage)	+ 80 °C
Min. permissible ambient motor temp. (transp./storage)	- 40 °C
Mounting position	Shaft horizontal or rotor on bottom; rotor on top on request
Condensate discharge holes	Rotor-side
Operation mode	S1
Motor bearing	Ball bearing
Touch current acc. IEC 60990 (measuring network Fig. 4, TN system)	<= 3.5 mA
Electrical leads	Via terminal box
Motor protection	Thermal overload protector (TOP) brought out, basic insulation
Protection class	I (if protective earth is connected by customer)
Product conforming to standard	EN 61800-5-1; EN 60034; CE
Approval	VDE; EAC




AC axial fan - HyBlade

sickled blades (S series)

with guard grille for full nozzle

Product drawing

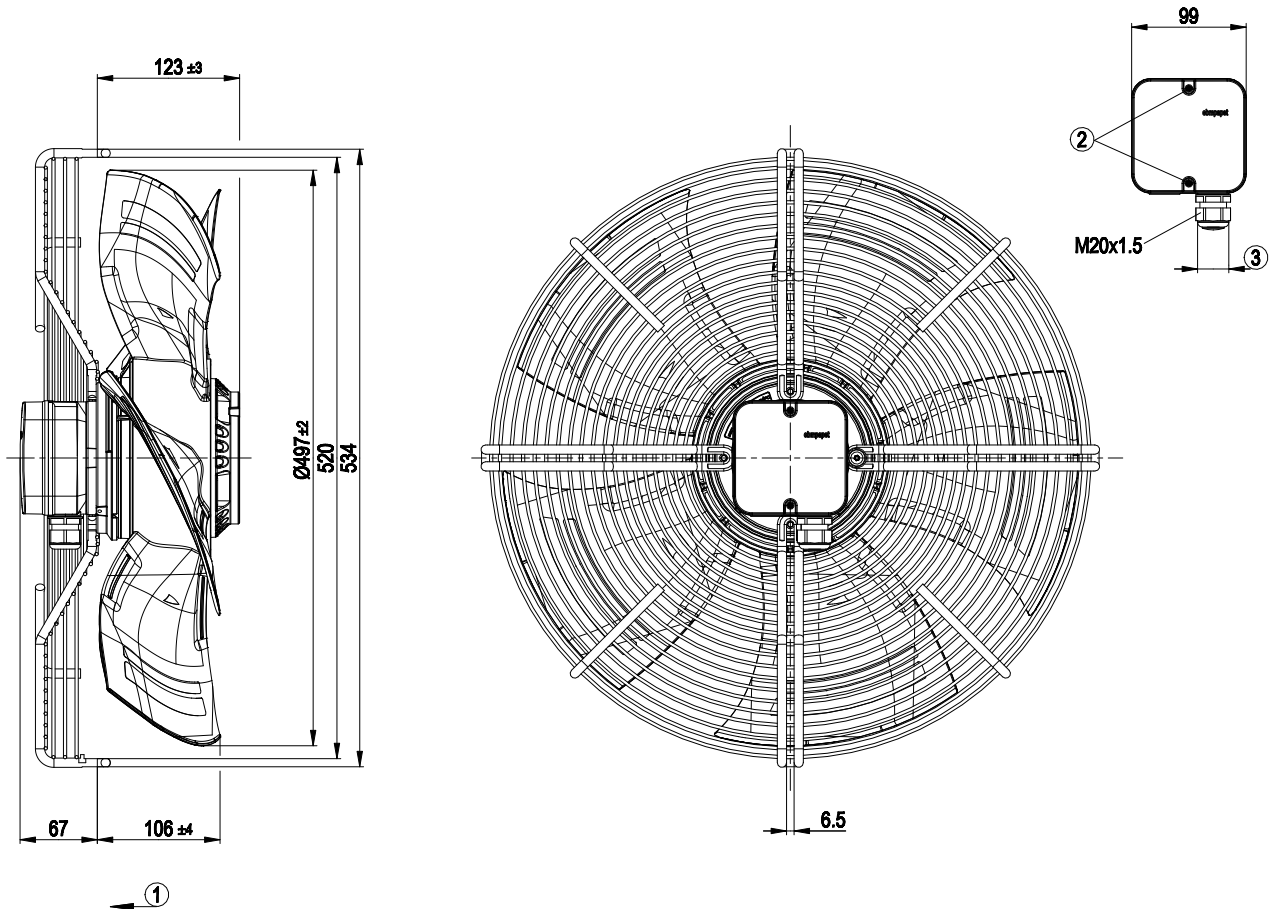


1	Direction of air flow "V"
2	Tightening torque 1.5 ± 0.2 Nm
3	Cable diameter: min. 6 mm, max. 12 mm, tightening torque 2 ± 0.3 Nm

AC axial fan - HyBlade

sickled blades (S series)
with guard grille for full nozzle

Connection screen

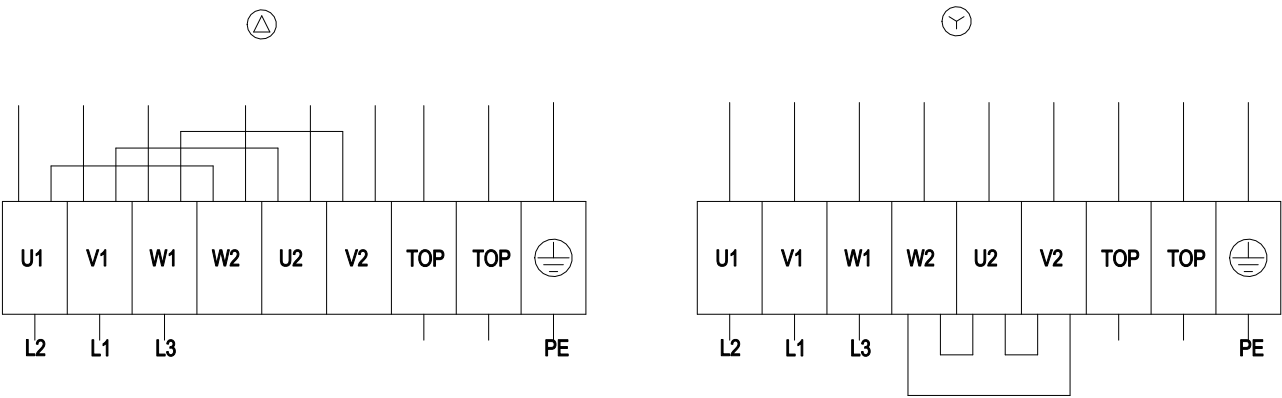

Δ	Delta connection	Y	Star connection	L1	= V1 = blue
L2	= U1 = black	L3	= W1 = brown	W2	yellow
U2	green	V2	white	TOP	2 x grey
PE	green/yellow				




AC axial fan - HyBlade

sickled blades (S series)

with guard grille for full nozzle

Charts: Air flow 50 Hz

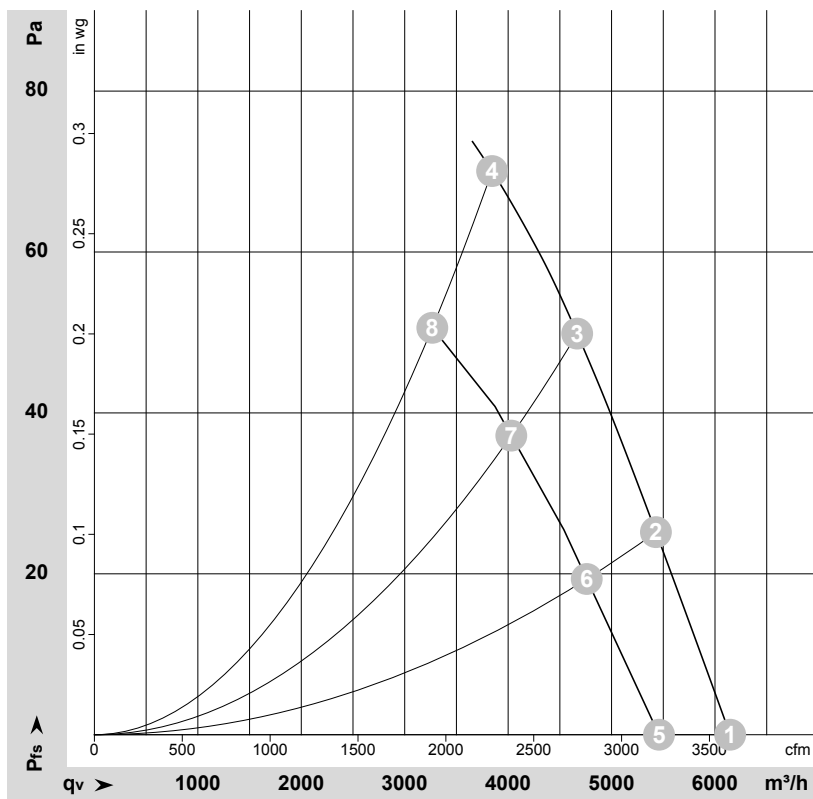

$$\rho = 1.15 \text{ kg/m}^3 \pm 2 \%$$

Measurement: LU-152524-1
Measurement: LU-167953-1

Air performance measured as per ISO 5801
Installation category A. For detailed
information on the measuring set-up, please
contact ebm-papst. Suction-side noise
levels: LwA measured as per ISO 13347 /
LpA measured with 1m distance to fan axis.
The values given are valid under the
measuring conditions mentioned above and
may vary according to the actual installation
situation. With any deviation from the
standard set-up, the specific values have to
be checked and reviewed with the unit
installed.

Measured values

	Conn.	U	f	n	P _e	I	LpA _{in}	LwA _{in}	LwA _{out}	q _v	p _{fs}	q _v	p _{fs}
		V	Hz	min ⁻¹	W	A	dB(A)	dB(A)	dB(A)	m³/h	Pa	cfm	inH ₂ O
1	Δ	400	50	945	202	0.58	62	68	68	6145	0	3620	0.00
2	Δ	400	50	940	225	0.59	59	66	65	5430	25	3195	0.10
3	Δ	400	50	930	245	0.60	56	63	63	4670	50	2745	0.20
4	Δ	400	50	920	260	0.63	55	62	62	3845	70	2265	0.28
5	Y	400	50	845	148	0.26	59	66	65	5460	0	3215	0.00
6	Y	400	50	820	163	0.28	56	63	62	4760	19	2800	0.08
7	Y	400	50	800	175	0.30	53	60	60	4030	37	2370	0.15
8	Y	400	50	785	190	0.32	51	58	57	3265	51	1925	0.20


Conn. = Connection · U = Supply voltage · f = Frequency · n = Speed (rpm) · P_e = Power input · I = Current draw · LpA_{in} = Sound pressure level inlet side · LwA_{in} = Sound power level inlet side
LwA_{out} = Sound power level outlet side · q_v = Air flow · p_{fs} = Pressure increase



AC axial fan - HyBlade

sickled blades (S series)
with guard grille for full nozzle

Charts: Air flow 60 Hz

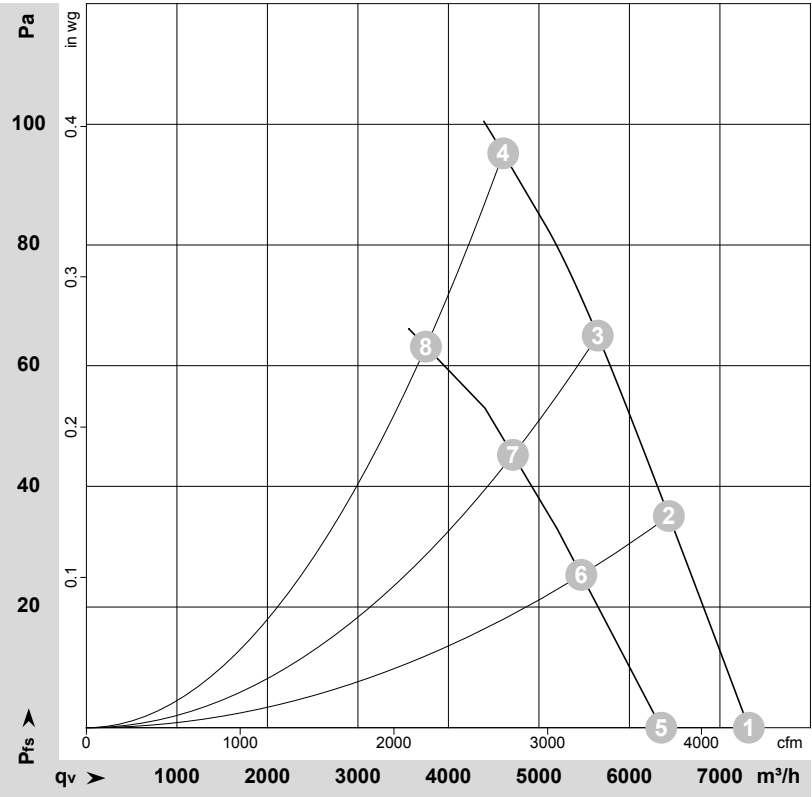

$\rho = 1.15 \text{ kg/m}^3 \pm 2 \%$

Measurement: LU-152527-1
Measurement: LU-167955-1

Air performance measured as per ISO 5801
Installation category A. For detailed
information on the measuring set-up, please
contact ebm-papst. Suction-side noise
levels: LwA measured as per ISO 13347 /
LpA measured with 1m distance to fan axis.
The values given are valid under the
measuring conditions mentioned above and
may vary according to the actual installation
situation. With any deviation from the
standard set-up, the specific values have to
be checked and reviewed with the unit
installed.

Measured values

	Conn.	U	f	n	P _e	I	LpA _{in}	LwA _{in}	LwA _{out}	q _v	p _{fs}	q _v	p _{fs}
		V	Hz	min ⁻¹	W	A	dB(A)	dB(A)	dB(A)	m ³ /h	Pa	cfm	inH ₂ O
1	Δ	480	60	1120	314	0.62	65	72	71	7320	0	4310	0.00
2	Δ	480	60	1110	350	0.65	62	69	69	6435	35	3790	0.14
3	Δ	480	60	1100	378	0.67	60	67	67	5650	65	3325	0.26
4	Δ	480	60	1090	410	0.72	59	66	66	4605	95	2710	0.38
5	Y	480	60	975	234	0.33	62	69	68	6350	0	3740	0.00
6	Y	480	60	940	257	0.36	59	65	65	5470	25	3220	0.10
7	Y	480	60	915	272	0.38	56	63	63	4715	45	2775	0.18
8	Y	480	60	880	290	0.41	54	61	61	3750	63	2210	0.25

Conn. = Connection · U = Supply voltage · f = Frequency · n = Speed (rpm) · P_e = Power input · I = Current draw · LpA_{in} = Sound pressure level inlet side · LwA_{in} = Sound power level inlet side
LwA_{out} = Sound power level outlet side · q_v = Air flow · p_{fs} = Pressure increase

