

AC axial fan

sickle-shaped blades (S series)

Fan housing with guard grille

W2D200-DH18-33 ebmpapst Datasheet

sales@fansco.com

www.fansco.com

Nominal data

Type	W2D200-DH18-33		
Motor	M2D068-BC		
Phase		3~	3~
Nominal voltage	VAC	230	230
Wiring		Δ	Δ
Frequency	Hz	50	60
Method of obtaining data		fa	fa
Valid for approval/standard		CE	CE
Speed (rpm)	min ⁻¹	2600	2900
Power consumption	W	68	70
Current draw	A	0.29	0.22
Max. back pressure	Pa	85	90
Max. back pressure	in. wg	0.34	0.36
Min. ambient temperature	°C	-25	-25
Max. ambient temperature	°C	45	70
Starting current	A	0.63	0.56

ml = Max. load · me = Max. efficiency · fa = Free air · cs = Customer specification · ce = Customer equipment
Subject to change



AC axial fan

sickle-shaped blades (S series)

Fan housing with guard grille

Technical description


Weight	2.3 kg
Size	200 mm
Motor size	68
Rotor surface	Painted black
Blade material	Sheet steel, painted black
Fan housing material	Sheet steel, pre-galvanized and coated with black plastic
Guard grille material	Steel, bright-galvanized and blue chromated
Number of blades	9
Airflow direction	V
Direction of rotation	Counterclockwise, viewed toward rotor
Degree of protection	IP44
Insulation class	"B"
Moisture (F) / Environmental (H) protection class	H1
Max. permitted ambient temp. for motor (transport/storage)	+ 80 °C
Min. permitted ambient temp. for motor (transport/storage)	- 40 °C
Installation position	Shaft horizontal or rotor on bottom; rotor on top on request
Condensation drainage holes	On rotor side
Mode	S1
Motor bearing	Ball bearing
Touch current according to IEC 60990 (measuring circuit Fig. 4, TN system)	< 0.75 mA
Motor protection	Thermal overload protector (TOP) with basic insulation
With cable	Lateral
Protection class	I (with customer connection of protective earth)
Conformity with standards	EN 60335-1, motor does not have factory-installed overheating protection; CE
Approval	CSA C22.2 No. 100; UL 1004-1



AC axial fan

sickle-shaped blades (S series)
Fan housing with guard grille

Product drawing

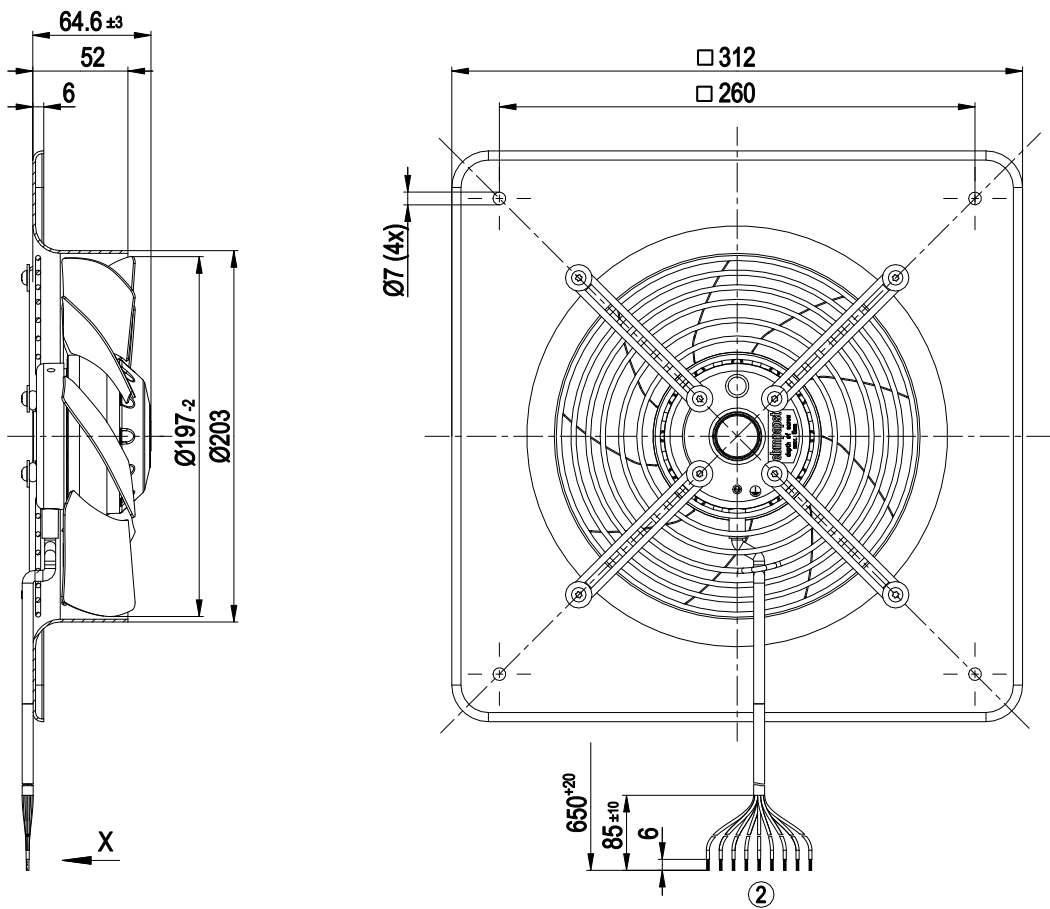


1	Airflow direction "V"
2	Cable PVC AWG20
	9x splice



AC axial fan

sickle-shaped blades (S series)
Fan housing with guard grille

Connection diagram

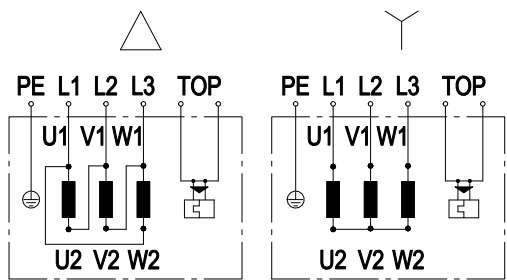

Note: Change of rotation direction by reversing two phases


Δ	Delta connection	Y	Star connection	L1	black
L2	blue	L3	brown	U1	black
V1	blue	W1	brown	U2	green
V2	white	W2	yellow	TOP	2x gray
PE	green/yellow				



AC axial fan

sickle-shaped blades (S series)
Fan housing with guard grille

Curves: Air performance 50 Hz

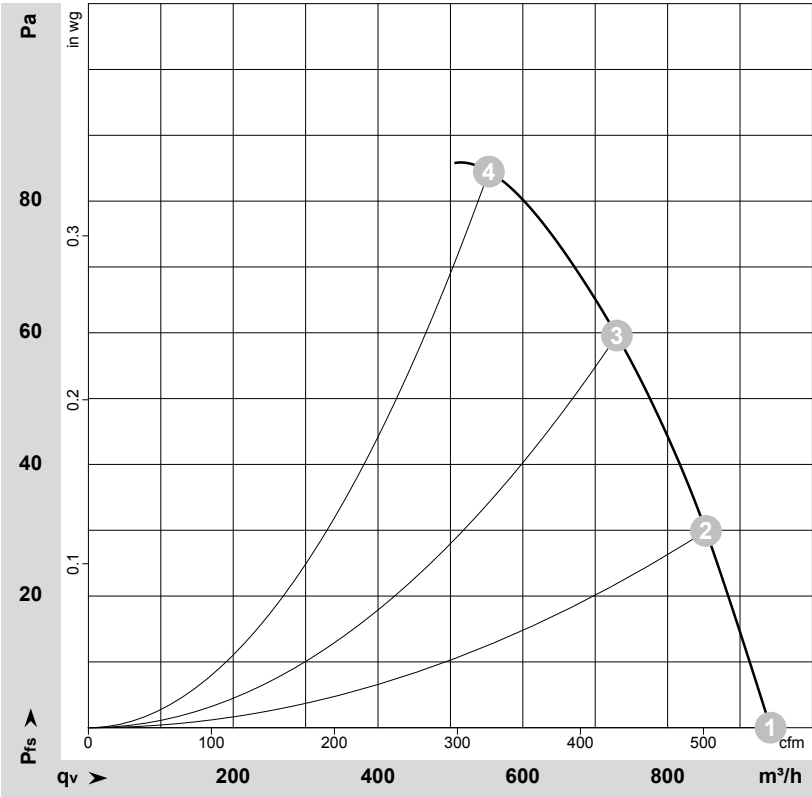

$\rho = 1.15 \text{ kg/m}^3 \pm 2 \%$

Measurement: LU-26980-1

Air performance measured according to ISO 5801 installation category A. For detailed information on the measurement setup, contact ebm-papst. Intake sound level: Sound power level according to ISO 13347 / sound pressure level measured at 1 m distance from fan axis. The values given are valid under the specified measuring conditions and may vary due to conditions of installation. For deviations from the standard configuration, the parameters have to be checked on the installed unit.

Measured values

	Wired	U	f	n	P _e	I	q _v	p _{fs}	q _v	p _{fs}
		V	Hz	min ⁻¹	W	A	m³/h	Pa	cfm	in. wg
1	Y	400	50	2600	68	0.17	940	0	555	0.00
2	Y	400	50	2550	70	0.16	855	30	500	0.12
3	Y	400	50	2500	73	0.16	730	60	430	0.24
4	Y	400	50	2460	75	0.16	555	85	325	0.34


Wired = Wiring · U = Voltage · f = Frequency · n = Speed (rpm) · P_e = Power consumption · I = Current draw · q_v = Air flow · p_{fs} = Pressure increase



AC axial fan

sickle-shaped blades (S series)
Fan housing with guard grille

Curves: Air performance 60 Hz

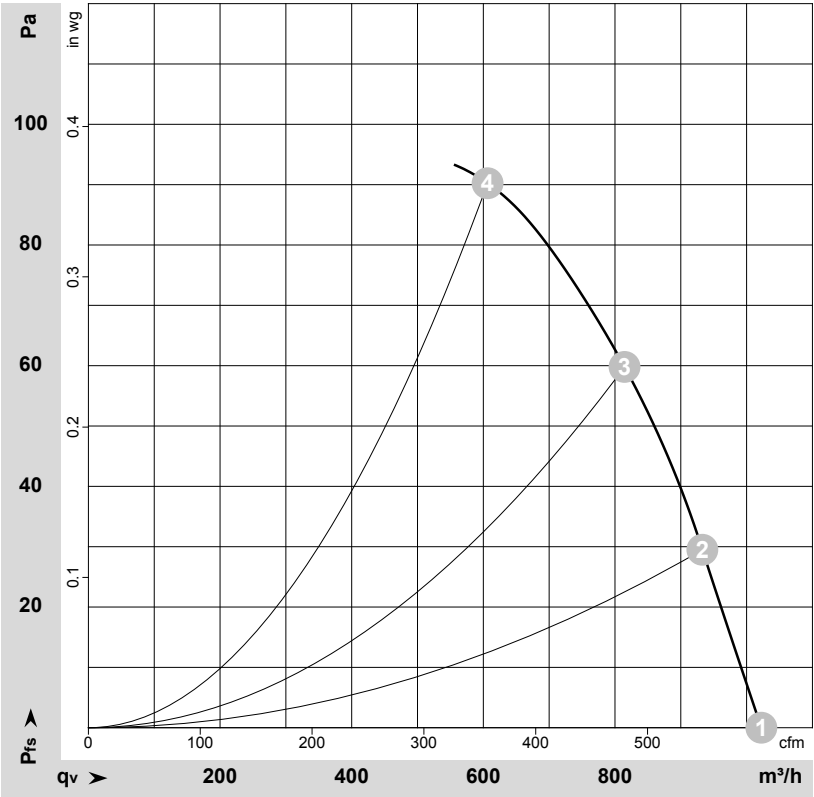

$\rho = 1.15 \text{ kg/m}^3 \pm 2 \%$

Measurement: LU-26981-1

Air performance measured according to ISO 5801 installation category A. For detailed information on the measurement setup, contact ebm-papst. Intake sound level: Sound power level according to ISO 13347 / sound pressure level measured at 1 m distance from fan axis. The values given are valid under the specified measuring conditions and may vary due to conditions of installation. For deviations from the standard configuration, the parameters have to be checked on the installed unit.

Measured values

	Wired	U	f	n	P _e	I	q _v	p _{fs}	q _v	p _{fs}
		V	Hz	min ⁻¹	W	A	m³/h	Pa	cfm	in. wg
1	Y	400	60	2900	70	0.13	1020	0	600	0.00
2	Y	400	60	2745	73	0.14	935	30	550	0.12
3	Y	400	60	2670	78	0.14	815	60	480	0.24
4	Y	400	60	2590	82	0.15	605	90	355	0.36

Wired = Wiring · U = Voltage · f = Frequency · n = Speed (rpm) · P_e = Power consumption · I = Current draw · q_v = Air flow · p_{fs} = Pressure increase

