

AC axial fan

sickled blades (S series)
Wall ring with guard grille

W4D420-CP02-40 ebmpapst Datasheet
sales@fansco.com
www.fansco.com

Nominal data

Type	W4D420-CP02-40						
Motor	M4D074-GA						
Phase		3~	3~	3~	3~	3~	3~
Nominal voltage	VAC	230	266	266	400	460	460
Connection		Δ	Δ	Δ	Y	Y	Y
Frequency	Hz	50	60	60	50	60	60
Type of data definition		fa	fa	fa	fa	fa	fa
Valid for approval / standard		CE	CE	UL 2111	CE	UL	CE
Speed (rpm)	min ⁻¹	1430	1680	1680	1430	1680	1680
Power input	W	160	265	265	160	275	265
Current draw	A	0.76	0.9	0.9	0.44	0.52	0.52
Max. back pressure	Pa	160	120	120	160	120	120
Min. ambient temperature	°C	-25	-25	-25	-25	-25	-25
Max. ambient temperature	°C	85	60	60	85	60	60

ml = Max. load · me = Max. efficiency · fa = Running at free air · cs = Customer specs · cu = Customer unit
Subject to alterations

Data according to ErP directive

		Actual	Request 2015			
01 Overall efficiency η_{es}	%	34.5	29.5	09 Power input P_e	kW	0.22
02 Measurement category	A			09 Air flow q_v	m³/h	3540
03 Efficiency category	Static			09 Pressure increase p_{fs}	Pa	81
04 Efficiency grade N	45	40		10 Speed (rpm) n	min ⁻¹	1395
05 Variable speed drive	No			11 Specific ratio*		1.00

Data definition with optimum efficiency.
The ErP data is determined using a motor-impeller combination in a standardised measurement configuration.

* Specific ratio = $1 + p_s / 100\,000\text{ Pa}$ LU-29817



AC axial fan

sickled blades (S series)

Wall ring with guard grille

Technical features

Mass	9 kg
Size	420 mm
Material of terminal box	ABS plastic
Material of impeller	Sheet steel (painted black)
Material of wall ring	Sheet steel, galvanised and coated in black plastic (RAL 9005)
Material of guard grille	Steel, coated in black plastic (RAL9005)
Number of blades	5
Direction of air flow	"A"
Direction of rotation	Clockwise, seen on rotor
Type of protection	IP 44
Insulation class	"F"
Humidity (F)/environmental protection class (H)	F2-2
Mounting position	Shaft horizontal or rotor on bottom; rotor on top on request
Condensate discharge holes	Rotor-side
Operation mode	S1
Motor bearing	Ball bearing
Touch current acc. IEC 60990 (measuring network Fig. 4, TN system)	< 0.75 mA
Electrical leads	Via terminal box
Cable exit	Variable
Protection class	I (if protective earth is connected by customer)
Product conforming to standard	EN 60335-1, motor does not have factory-installed overheating protection; CE
Approval	CSA C22.2 No.100; UL 1004-1




AC axial fan

sickled blades (S series)

Wall ring with guard grille

Product drawing

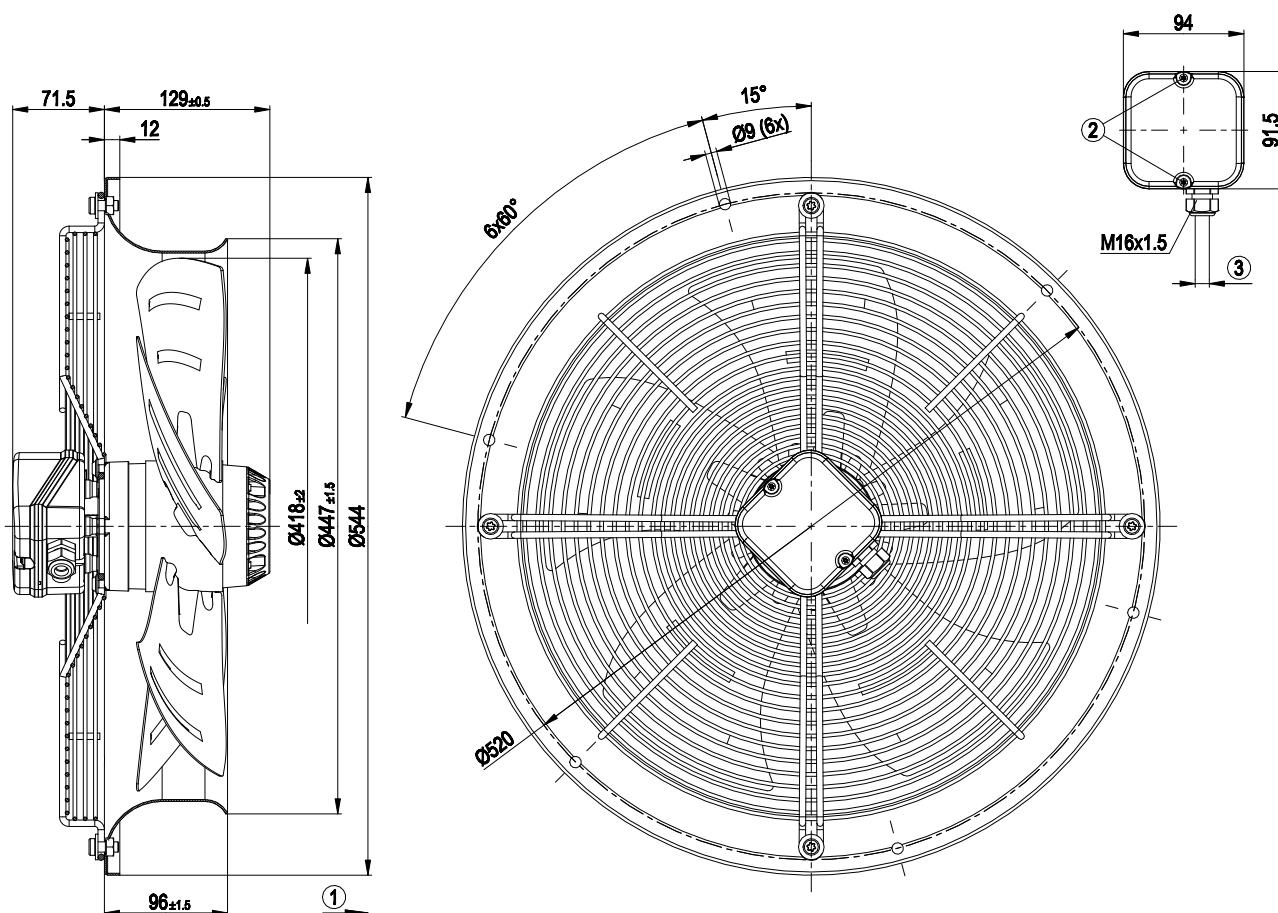


1	Direction of air flow "A"
2	Tightening torque 0.5 ± 0.1 Nm
3	Cable diameter min. 5 mm, max. 10 mm, tightening torque 2 ± 0.3 Nm

AC axial fan

sickled blades (S series)
Wall ring with guard grille

Connection screen

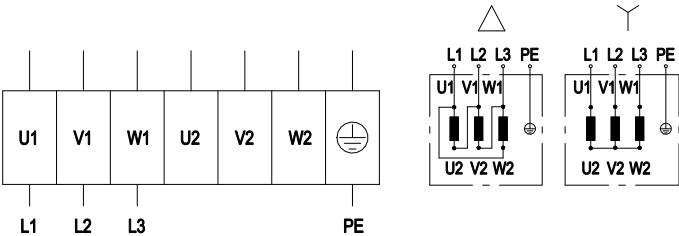


	Three-phase motor	Y	Star connection	Δ	Delta connection
L1	= U1 = black	L2	= V1 = blue	L3	= W1 = brown
U2	green	V2	white	W2	yellow
PE	PE (green/yellow)				



AC axial fan
sickled blades (S series)
Wall ring with guard grille

Charts: Air flow 50 Hz

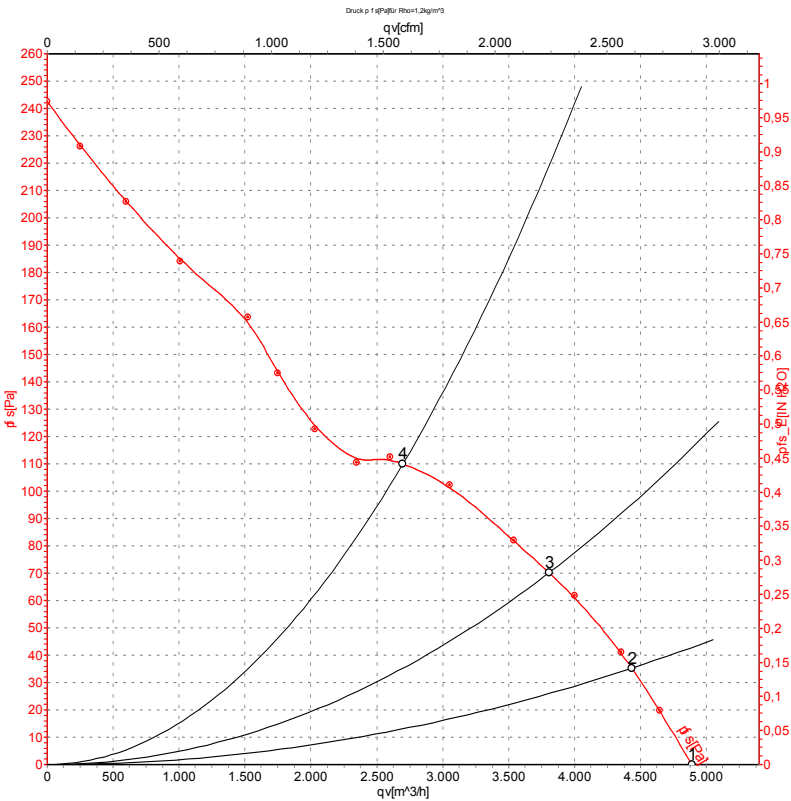

Measurement: LU-29817-1

Air performance measured as per ISO 5801
Installation category A. For detailed
information on the measuring set-up, please
contact ebm-papst. Suction-side noise
levels: L_{WA} measured as per ISO 13347 /
L_{pA} measured with 1m distance to fan axis.
The values given are valid under the
measuring conditions mentioned above and
may vary according to the actual installation
situation. With any deviation from the
standard set-up, the specific values have to
be checked and reviewed with the unit
installed.

Measured values


	U	f	n	P _e	I	q _v	p _{fs}	q _v	p _{fs}
	V	Hz	min ⁻¹	W	A	m³/h	Pa	cfm	inH ₂ O
1	400	50	1430	160	0.44	4890	0	2880	0.00
2	400	50	1420	188	0.48	4435	35	2610	0.14
3	400	50	1400	218	0.51	3805	70	2240	0.28
4	400	50	1375	256	0.55	2700	110	1590	0.44

U = Supply voltage · f = Frequency · n = Speed (rpm) · P_e = Power input · I = Current draw · q_v = Air flow · p_{fs} = Pressure increase



AC axial fan
sickled blades (S series)
Wall ring with guard grille

Charts: Air flow 60 Hz

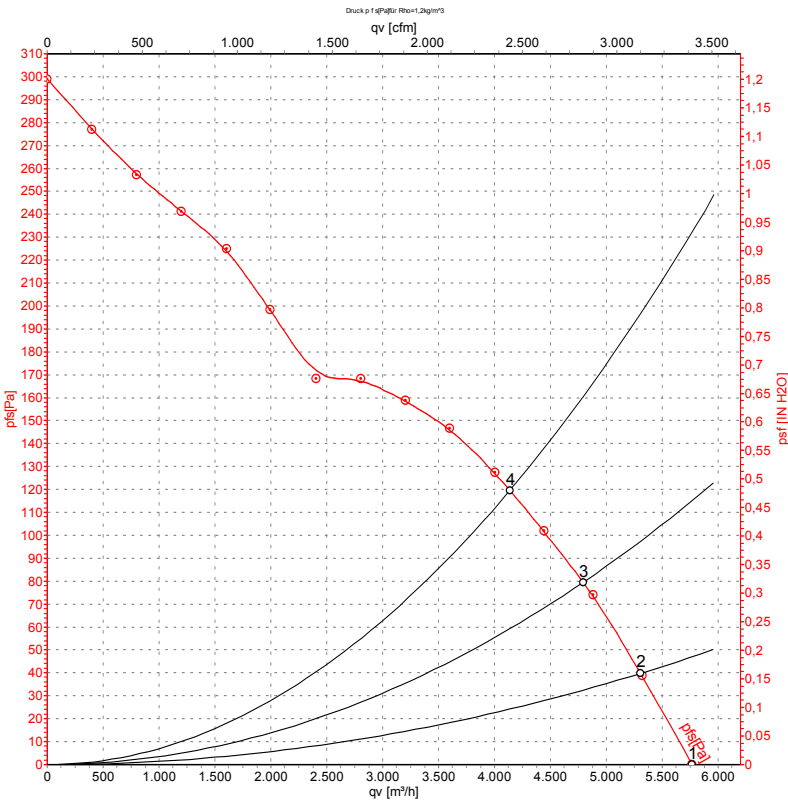

Measurement: LU-141005-1

Air performance measured as per ISO 5801
Installation category A. For detailed
information on the measuring set-up, please
contact ebm-papst. Suction-side noise
levels: L_{WA} measured as per ISO 13347 /
L_{pA} measured with 1m distance to fan axis.
The values given are valid under the
measuring conditions mentioned above and
may vary according to the actual installation
situation. With any deviation from the
standard set-up, the specific values have to
be checked and reviewed with the unit
installed.

Measured values

	Conn.	U	f	n	P _e	I	q _v	p _{fs}	q _v	p _{fs}
		V	Hz	min ⁻¹	W	A	m³/h	Pa	cfm	inH2O
1	Y. AUS	460	60	1680	265	0.52	5770	0	3395	0.00
2	Y. AUS	460	60	1640	302	0.53	5305	40	3125	0.16
3	Y. AUS	460	60	1600	340	0.61	4790	80	2820	0.32
4	Y. AUS	460	60	1590	371	0.62	4135	120	2435	0.48

Conn. = Connection · U = Supply voltage · f = Frequency · n = Speed (rpm) · P_e = Power input · I = Current draw · q_v = Air flow · p_{fs} = Pressure increase

